

# S20 digital output module 64 outputs

R911346598  
Edition 02

## Data sheet S20-DO-64/1

64 digital outputs 500 mA  
DC 24V  
1-conductor technology

10 / 2022



## 1 Description

The module is designed for use within an S20 station.  
It is used to output digital signals.

The outputs are protected against short circuit and  
overload.

### Features

- 64 digital outputs
- 24 V DC, 500 mA
- Connection of actuators in 1-conductor technology
- Minimum update time of < 100 µs
- Device rating plate stored

### Valid from index AC1.

The deviating behavior of the modules with an earlier index is documented in the corresponding points.

This data sheet is only valid in association with the application description for the S20 system, material number R911335988.

Make sure you always use the latest documentation.

It can be downloaded under [www.boschrexroth.com/electrics](http://www.boschrexroth.com/electrics).

**2 Table of contents**

1	Description .....	1
2	Table of contents .....	2
3	Ordering data .....	3
4	Technical data .....	3
5	Maximum outputs power consumption when inductive loads are switched off .....	7
6	Internal circuit diagram .....	7
7	For your safety.....	8
7.1	Intended use .....	8
7.2	Qualification of users .....	8
7.3	Electrical safety.....	8
7.4	Installation .....	8
8	UL note.....	8
9	Terminal point assignment.....	9
10	Connection example.....	9
11	Local diagnostic and status indicators .....	10
12	Process data.....	11
13	Parameter, diagnostics and information (PDI) .....	12
14	Standard objects .....	13
14.1	Objects for identification (device rating plate).....	13
14.2	Miscellaneous standard objects .....	14
14.3	Diagnostics state (0018hex: DiagState).....	15
15	Application objects .....	17
15.1	Substitute value behavior (FF8Dhex: PD Output Substitute Configuration) .....	17
15.2	Message "Actuator supply not present" (FF8Fhex: DiagOut).....	17
16	Device descriptions .....	18

### 3 Ordering data


Description	Type	MNR	Pcs./Pkt.
S20 digital output module 64 outputs	S20-DO-64/1	R911173742	1
Accessories	Type	MNR	Pcs./Pkt.
S20 bus base module	S20-BS	R911172540	5
Documentation	Type	MNR	Pcs./Pkt.
Application description S20: System and Installation	DOK-CONTRL- S20*SYS*INS-AP..-EN-P	R911335988	1
Application description S20: Error Messages	DOK-CONTRL- S20*DIAG*ER-AP..-EN-P	R911344826	1

#### Additional ordering data

For additional ordering data (accessories), please refer to the product catalog at [www.boschrexroth.com/electrics](http://www.boschrexroth.com/electrics).

### 4 Technical data

#### Dimensions (nominal sizes in mm)

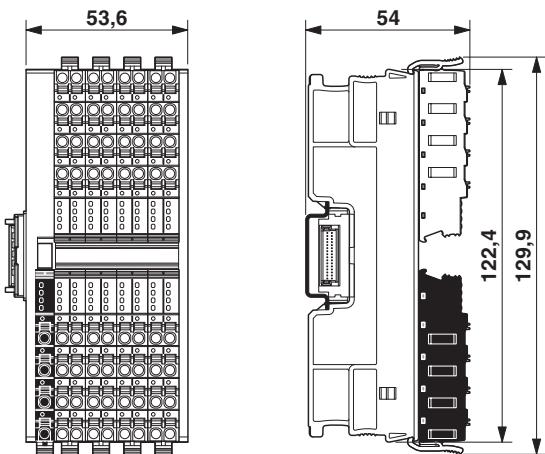

Width	53.6 mm
Height	129.9 mm
Depth	54 mm
Note on dimensions	The depth applies when a TH 35-7.5 DIN rail is used (in accordance with EN 60715).

#### General data

Color	light grey RAL 7035
Weight	260 g (with connectors and bus base module)
Ambient temperature (operation)	-25 °C ... 60 °C
Ambient temperature (storage/transport)	-40 °C ... 85 °C
Permissible humidity (operation)	5 % ... 95 % (non-condensing)
Permissible humidity (storage/transport)	5 % ... 95 % (non-condensing)
Air pressure (operation)	70 kPa ... 106 kPa (up to 3000 m above sea level)
Air pressure (storage/transport)	70 kPa ... 106 kPa (up to 3000 m above sea level)

<b>General data</b>	
Degree of protection	IP20
Protection class	III (IEC 61140, EN 61140, VDE 0140-1)
Overvoltage category	II (IEC 60664-1, EN 60664-1)
Degree of pollution	2 (IEC 60664-1, EN 60664-1)
Mounting type	DIN rail mounting
Mounting position	any (no temperature derating)
<b>Connection data: S20 connector</b>	
Connection method	Push-in connection
Conductor cross section, rigid	0.2 mm <sup>2</sup> ... 1.5 mm <sup>2</sup>
Conductor cross section, flexible	0.2 mm <sup>2</sup> ... 1.5 mm <sup>2</sup>
Conductor cross section [AWG]	24 ... 16
Stripping length	8 mm
Note	Observe the specifications for the conductor cross sections in the application description for the S20 system, material number R911335988.
<b>Interface: Local bus</b>	
Number of interfaces	2
Connection method	Bus base module
Transmission speed	100 Mbps
<b>Supply of the local bus (U<sub>Bus</sub>)</b>	
Supply voltage	5 V DC (via bus base module)
Current consumption	max. 120 mA (up to index AB1) max. 60 mA (from index AC1)
Power consumption	max. 600 mW (up to index AB1) max. 300 mW (from index AC1)
<b>Supply for digital output modules (U<sub>O</sub>)</b>	
Supply voltage	24 V DC
Supply voltage range	19.2 V DC ... 30 V DC (including all tolerances, including ripple)
Current consumption	min. 50 mA (without actuators) max. 16 A (Provide external protection; if the total current of 8 A is exceeded, connect the supply at the power connector parallel via both terminal points.)
Power consumption	typ. 1.2 W (without actuators) max. 480 W (of which 1.8 W internal losses)
Surge protection	electronic (35 V, 0.5 s)
Reverse polarity protection	parallel diode; with external 5 A fuse (only for commissioning)
Protection	max. 16 A (polarity reversal protection up to 5 A)
<b>NOTICE Damage to the electronics</b>	
Provide external protection for the module to ensure reverse polarity protection. If you use a fuse, the power supply unit must be capable of supplying four times the nominal current of the fuse. This ensures that the fuse trips reliably in the event of a fault.	
 When using the module for the first time, protect it with a 5 A fuse. When all modules in the system are correctly connected, the 5 A fuse can be replaced with a 16 A fuse. After that, you can load the module by up to 16 A. When doing so, observe the derating. Loads over 16 A are not permitted.	

<b>Digital outputs</b>	
Number of outputs	64
Connection method	Push-in connection
Connection technology	1-conductor
Nominal output voltage	24 V DC
Output current per channel	max. 500 mA
Output current of the device	max. 16 A (Provide external protection; if the total current of 8 A is exceeded, connect the supply at the power connector parallel via both terminal points.)
Nominal load, ohmic	max. 12 W (48 Ω, with nominal voltage)
Nominal load, inductive	max. 12 VA (1.2 H, 48 Ω, with nominal voltage)
Nominal load, lamp	max. 12 W (at nominal voltage)
Load min.	10 kΩ
Energy consumption	see diagram
Limitation of the voltage induced on circuit interruption	-25.8 V ... -15 V
Output voltage when switched off	max. 1 V
Output current when switched off	max. 300 µA
Signal delay	max. 100 µs (when switched on) max. 100 µs (during switching off with ohmic nominal load)
Switching frequency	max. 10000 per second (with ohmic load) max. 1 per second (with inductive load) max. 16 per second (with nominal lamp load)
Short-circuit protection, overload protection of the outputs	electronic
Behavior with overload	Shutdown with automatic restart
Behavior with inductive overload	Output can be destroyed
Reverse voltage resistance to short pulses	limited protection up to 0.5 A for 1 s
Overcurrent shut-down	as of 0.7 A
Output current with ground connection interrupt when switched off	< 1 mA
Process data update	< 100 µs
<b>Input and output address area</b>	
Input address area	0 Byte
Output address area	8 Byte
<b>Configuration and parameter data in a PROFIBUS system</b>	
Required parameter data	1 Byte
Required configuration data	6 Byte
<b>Electrical isolation/isolation of the voltage areas</b>	
<b>Test section</b>	
5 V supply of the local bus ( $U_{Bus}$ ) / 24 V supply (I/Os)	500 V AC, 50 Hz, 1 min.
5 V supply of the local bus ( $U_{Bus}$ ) / functional ground	500 V AC, 50 Hz, 1 min.
24 V supply (I/O) / functional ground	500 V AC, 50 Hz, 1 min.
<b>Test voltage</b>	
<b>Mechanical tests</b>	
Vibration resistance in accordance with EN 60068-2-6/IEC 60068-2-6	5g
Shock in accordance with EN 60068-2-27/IEC 60068-2-27	30g
Continuous shock in accordance with EN 60068-2-27/IEC 60068-2-27	10g

**Conformance with EMC Directive 2014/30/EU****Immunity test in accordance with EN 61000-6-2/IEC 61000-6-2**

Electrostatic discharge (ESD) EN 61000-4-2/IEC 61000-4-2	Criterion B, 6 kV contact discharge, 8 kV air discharge
---	---

Electromagnetic fields EN 61000-4-3/IEC 61000-4-3	Criterion A, Field intensity: 10 V/m
--	--------------------------------------

Fast transients (burst) EN 61000-4-4/IEC 61000-4-4	Criterion B, 2 kV
---	-------------------

Transient overvoltage (surge) EN 61000-4-5/IEC 61000-4-5	Criterion B, DC supply lines: $\pm 0.5 \text{ kV}/\pm 1.0 \text{ kV}$ (symmetrical/ asymmetrical)
---	--

Conducted interference EN 61000-4-6/IEC 61000-4-6	Criterion A, Test voltage 10 V
--	--------------------------------

**Noise emission test in accordance with  
EN 61000-6-3/IEC 61000-6-3****Approvals**


For the current approvals, please visit [www.boschrexroth.com/electrics](http://www.boschrexroth.com/electrics).

## 5 Maximum outputs power consumption when inductive loads are switched off

### NOTICE Damage to the electronics

 Restrict freewheeling voltage to a maximum of -17 V when using an external freewheeling circuit! The external freewheeling circuit does not function in the case of higher negative voltages.

Fig. 1 Maximum outputs power consumption when inductive loads are switched off

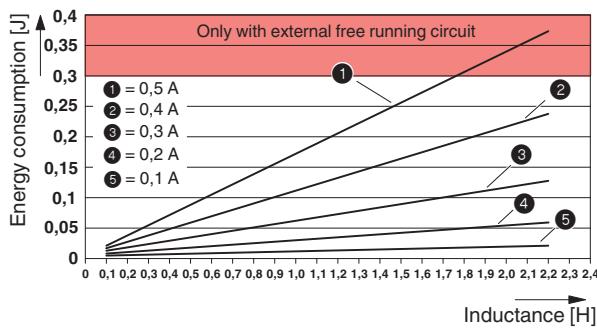


The specifications in the diagram refer to a maximum switching frequency of 1 Hz.

The diagram shows the maximum amount of energy that may be fed back into the corresponding output groups (outputs 1 to 8, 9 to 16, ..., 57 to 64) for each switch-off procedure when switching off an inductive load without external freewheeling circuit.

The current data refers to the ohmic DC voltage component of the inductive load.

## 6 Internal circuit diagram

Fig. 2 Internal wiring of the terminal points

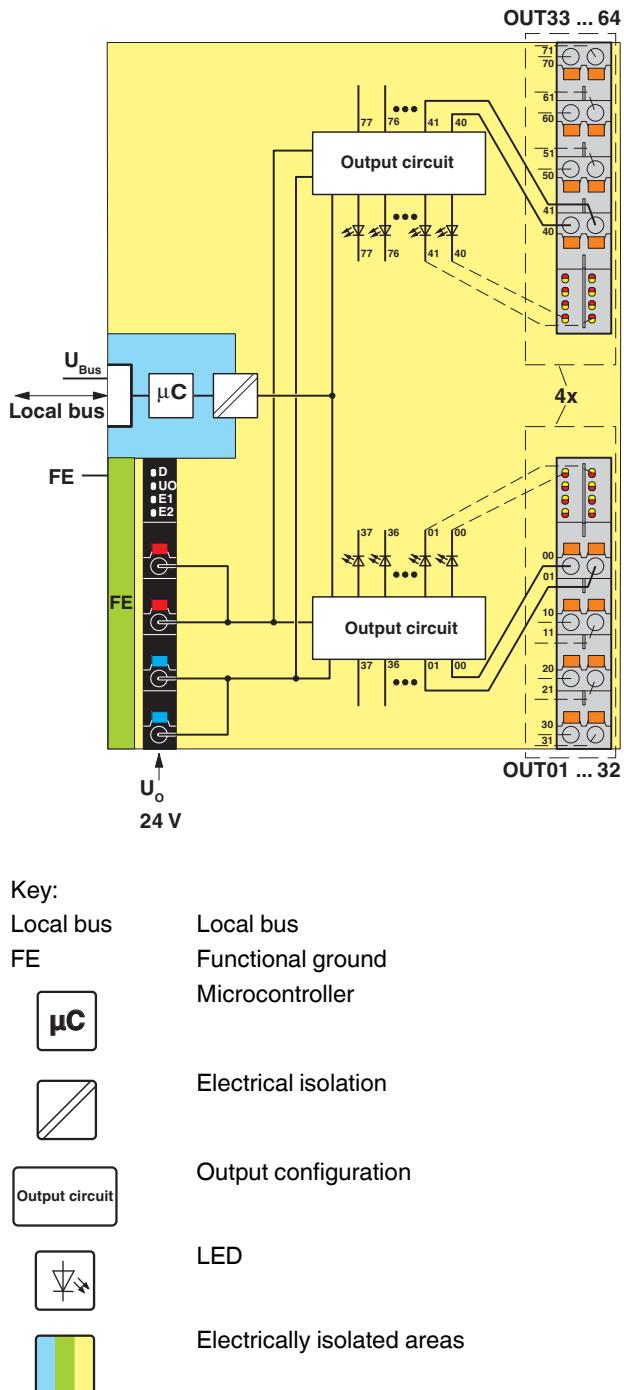

## 7 For your safety

### 7.1 Intended use

Only use S20 modules in accordance with the information in this data sheet and in the application description for the S20 system, material number R911335988.

### 7.2 Qualification of users

The use of products described in this data sheet is oriented exclusively to electrically skilled persons or persons instructed by them. The users must be familiar with the relevant safety concepts of automation technology as well as applicable standards and other regulations.

### 7.3 Electrical safety



#### WARNING: loss of electrical safety

If used incorrectly, device safety may be impaired.

During installation, startup, and operation, observe the notes in this data sheet and the specifications in the application description for the S20 system, material number R911335988.

### 7.4 Installation

Only install the S20 modules in a control cabinet or junction box.

The enclosure must meet the requirements regarding the protection against spread of fire according to the following standards:


- EN 61010-1/IEC 61010-1
- UL 61010-1 (for applications with UL approval)

## 8 UL note

- Use copper conductors only.

## 9 Terminal point assignment

Fig. 3 Terminal point assignment

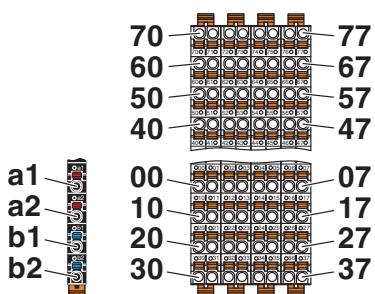

Terminal point	Color	Assignment	
<b>Supply voltage input</b>			
a1, a2	Red	24 V DC ( $U_O$ )	Supply for digital output modules (bridged internally)
b1, b2	Blue	GND	Reference potential of the supply voltage (bridged internally)
<b>Digital outputs</b>			
00 ... 07	Orange	OUT01 ... OUT08	Digital outputs 1 ... 8
10 ... 17	Orange	OUT09 ... OUT16	Digital outputs 9 ... 16
20 ... 27	Orange	OUT17 ... OUT24	Digital outputs 17 ... 24
30 ... 37	Orange	OUT25 ... OUT32	Digital outputs 25 ... 32
40 ... 47	Orange	OUT33 ... OUT40	Digital outputs 33 ... 40
50 ... 57	Orange	OUT41 ... OUT48	Digital outputs 41 ... 48
60 ... 67	Orange	OUT49 ... OUT56	Digital outputs 49 ... 56
70 ... 77	Orange	OUT57 ... OUT64	Digital outputs 57 ... 64



Take the contacts' maximum load capacity of 8 A into account!

If the supply voltage  $U_O$  is supplied in parallel via both connections a1 and a2 as well as b1 and b2, the module can be loaded with up to a maximum of 16 A.

## 10 Connection example

Fig. 4 Parallel supply of the supply voltage


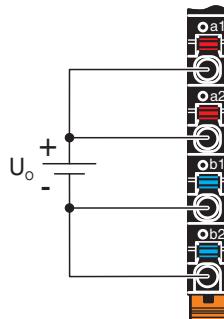


Fig. 5 Connection in 1-conductor technology

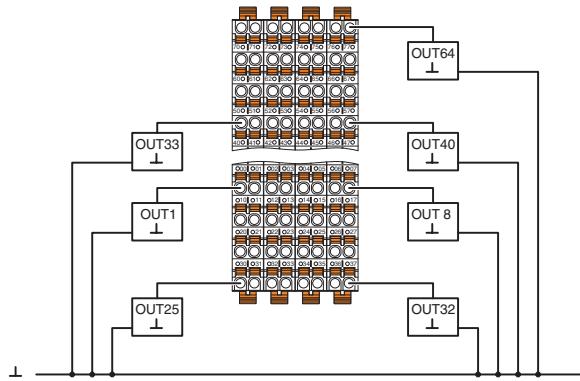


Make sure that the GND of the actuators and the GND for  $U_O$  have the same potential!

## 11 Local diagnostic and status indicators

### From index AC1

Fig. 6 Local diagnostic and status indicators

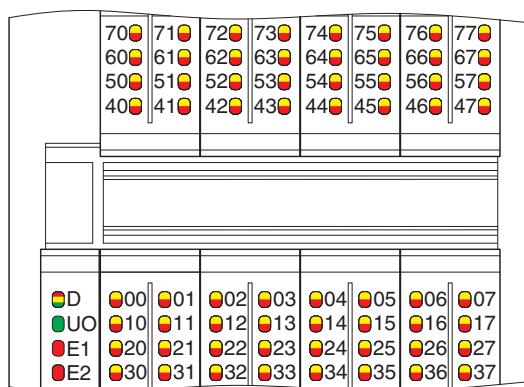

Channel errors are errors that can be associated with a channel.

I/O errors are errors that affect the entire module.

Designa-tion	Color	Meaning	State	Description	
D	Red/ yellow/ green	Diagnostics of local bus communication			
		Run		Green on	The device is ready for operation, communication within the station is OK. All data is valid. An error has not occurred.
		Active		Flashing green	The device is ready to operate, communication within the station is OK. The data is <b>not</b> valid. The controller or higher-level network is not delivering valid data. There is no error on the module.
		Device application not active		Flashing green/yellow	The device is ready for operation, communication within the station is OK. Output data <b>cannot</b> be outputted and/or input data <b>cannot</b> be read. There is a fault on the periphery side of the module..
		Ready		Yellow on	The device is ready for operation but did not detect a valid cycle after power-up.
		Connected		Flashing yellow	The device is not (yet) part of the active configuration.
		Reset		Red on	The device is ready for operation but has lost the connection to the bus head.
		Not connected		Flashing red	The device is ready for operation but there is no connection to the previously existing device.
Power down		Off		Device is in (power) reset.	
U <sub>O</sub>	Green	U <sub>Output</sub>	On	Supply for digital output modules present.	
			Off	Supply for digital output modules is not present.	
E1	Red	I/O error	On	I/O error present.	
			Off	No I/O error.	
E2	Red	Channel error	On	Channel error present.	
			Off	Channel error not present.	
00 ... 77	Red/ yellow	Diagnostics/status of the output	Red on	Short-circuit/overload of the output.	
			Yellow on	Output is set.	
			Off	No error, output is not set.	

### Deviating behavior up to index AB1

The LED E2 is not present.

Designation	Color	Meaning	State	Description
E1	Red	I/O error	On	Breakdown or overload/short-circuit of an output.
			Off	No I/O error.

## 12 Process data

The process data is mapped in Motorola format (Big Endian).

### OUT process data

Byte	0							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 08	OUT 07	OUT 06	OUT 05	OUT 04	OUT 03	OUT 02	OUT 01
Terminal point	07	06	05	04	03	02	01	00

Byte	4							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 40	OUT 39	OUT 38	OUT 37	OUT 36	OUT 35	OUT 34	OUT 33
Terminal point	47	46	45	44	43	42	41	40

Byte	1							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 16	OUT 15	OUT 14	OUT 13	OUT 12	OUT 11	OUT 10	OUT 09
Terminal point	17	16	15	14	13	12	11	10

Byte	5							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 48	OUT 47	OUT 46	OUT 45	OUT 44	OUT 43	OUT 42	OUT 41
Terminal point	57	56	55	54	53	52	51	50

Byte	2							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 24	OUT 23	OUT 22	OUT 21	OUT 20	OUT 19	OUT 18	OUT 17
Terminal point	27	26	25	24	23	22	21	20

Byte	6							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 56	OUT 55	OUT 54	OUT 53	OUT 52	OUT 51	OUT 50	OUT 49
Terminal point	67	66	65	64	63	62	61	60

Byte	3							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 32	OUT 31	OUT 30	OUT 29	OUT 28	OUT 27	OUT 26	OUT 25
Terminal point	37	36	35	34	33	32	31	30

Byte	7							
Bit	7	6	5	4	3	2	1	0
Signal	OUT 64	OUT 63	OUT 62	OUT 61	OUT 60	OUT 59	OUT 58	OUT 57
Terminal point	77	76	75	74	73	72	71	70

## 13 Parameter, diagnostics and information (PDI)

Parameter and diagnostic data as well as other information is transmitted as objects via the PDI channel of the S20 station.

In IndraWorks, these parameters are displayed in the configurator.

The standard and application objects stored in the module are described in the following section.

The following applies to all tables below:

For an explanation of the data types, please refer to the application description for the S20 system, material number R911335988.

Abbreviation	Meaning
A	Number of elements
L	Length of the elements in bytes
R	Read
W	Write

 Each visible string is terminated with a null terminator ( $00_{hex}$ ). The length of a visible-string-type element is therefore at least one byte larger than the number of user data items.

If the number of user data items plus null terminator is smaller than the specified length of the element, the visible string will be populated with a null character ( $00_{hex}$ ).

 For detailed information on PDI objects, please refer to the application description for the S20 system, material number R911335988.

## 14 Standard objects

### 14.1 Objects for identification (device rating plate)

From index AC1

Index (hex)	Object name	Data type	A	L	Rights	Meaning	Contents
<b>Manufacturer</b>							
0001	VendorName	Visible String	1	32	R	Vendor name	Bosch Rexroth AG
0002	VendorID	Visible String	1	7	R	Vendor ID	006034
0012	VendorURL	Visible String	1	58	R	Vendor URL	<a href="http://www.boschrexroth.com">http://www.boschrexroth.com</a>
<b>Module - general</b>							
0004	DeviceFamily	Visible String	1	16	R	Device family	I/O digital OUT
0006	ProductFamily	Visible String	1	32	R	Product family	IndraControl S20
000E	CommProfile	Visible String	1	4	R	Communication profile	633
000F	DeviceProfile	Visible String	1	5	R	Device profile	0010
0011	ProfileVersion	Record of Visible Strings	2	11; 21	R	Profile version	2011-12-07; Basic - Profile V2.0
0017	Language	Record of Visible Strings	2	6; 8	R	Language	en-us; English
<b>Module - special</b>							
0005	Capabilities	Visible String	1	8	R	Capabilities	Nothing
0007	ProductName	Visible String	1	32	R	Product name	S20-DO-64/1
0008	SerialNo	Visible String	1	22	R	Serial number	xx xx xx xx xx xx xx x (e.g., 7602012346BC125)
0009	ProductText	Visible String	1	58	R	Product text	64 digital output channels
000A	OrderNumber	Visible String	1	32	R	Item No.	R911173742
000B	HardwareVersion	Record of Visible Strings	2	11; 11	R	Hardware version	e.g., 2020-04-26; AA1
000C	FirmwareVersion	Record of Visible Strings	2	11; 11	R	Firmware version	e.g., 2017-12-31; 1.00
000D	PChVersion	Record of Visible Strings	2	11; 6	R	PDI version	e. g., 2010-06-21; V1.00
0037	DeviceType	Octet string	1	8	R	Device type	00 40 00 08 00 00 00 DF <sub>hex</sub>
003A	VersionCount	Array of UINT16	4	4 * 2	R	Version counter	e.g., 0007 0001 0001 0001 <sub>hex</sub>
<b>Use of the device</b>							
0014	Location	Visible String	1	58	R/W	Location	Can be completed by the user.
0015	EquipmentIdent	Visible String	1	58	R/W	Equipment identifier	Can be completed by the user.
0016	ApplDeviceAddr	UINT16	1	2	R/W	Application-specific device address	Can be completed by the user.

### Deviating behavior up to index AB1

Index (hex)	Object name	Data type	A	L	Rights	Meaning	Contents
<b>Manufacturer</b>							
0001	VendorName	Visible String	1	17	R	Vendor name	Bosch Rexroth AG
0012	VendorURL	Visible String	1	28	R	Vendor URL	http://www.boschrexroth.com
<b>Module - general</b>							
0006	ProductFamily	Visible String	1	17	R	Product family	IndraControl S20
0011	ProfileVersion	Record of Visible Strings	2	11; 20	R	Profile version	2011-12-07; Basis - Profil V2.0
003A	VersionCount	UINT16	4	4 * 2	R	Version counter	e.g., 0007 0001 0000 0000 <sub>hex</sub>
<b>Module - special</b>							
0007	ProductName	Visible String	1	12	R	Product name	S20-DO-64/1
0008	SerialNo	Visible String	1	16	R	Serial number	xx xx xx xx xx xx xx x (e. g., 7602012346BC125)
0009	ProductText	Visible String	1	27	R	Product text	64 digital output channels
000A	OrderNumber	Visible String	1	11	R	Item No.	R911173742
000B	HardwareVersion	Record of Visible Strings	2	11; 4	R	Hardware version	e.g., 2020-04-26; AA1
000C	FirmwareVersion	Record of Visible Strings	2	11; 3	R	Firmware version	0000-00-00; --

### 14.2 Miscellaneous standard objects

Index (hex)	Object name	Data type	A	L	Rights	Meaning/contents	
<b>Diagnostics objects</b>							
0018	DiagState	Record	6	58	R	Diagnostic state	*
<b>Objects for process data management</b>							
0026	PDOUT	Octet string	1	8	R	OUT process data The structure corresponds to the representation in the "Process data" section.	

The objects identified with \* in the last column are described in more detail in the following sections.

The description of the other objects is to be found in the application description for the S20 system, material number R911335988.

### 14.3 Diagnostics state (0018<sub>hex</sub>: DiagState)

This object is used for a structured message of an error.

From index AC1

0018 <sub>hex</sub> : Diagnostics state (read)				
Subindex	Data type	Length in bytes	Meaning	Contents
0	Record	58	Diagnostic state	Complete diagnostics information
1	UINT16	2	Error number	0 ... 65535 <sub>dec</sub>
2	UINT8	1	Priority	00 <sub>hex</sub> No error
				01 <sub>hex</sub> Error
				02 <sub>hex</sub> Warning
				81 <sub>hex</sub> Error removed
				82 <sub>hex</sub> Warning eliminated
3	UINT8	1	Channel/group/module	00 <sub>hex</sub> No error
				01 <sub>hex</sub> Channel 1 (OUT01)
				... ...
				40 <sub>hex</sub> Channel 64 (OUT64)
				FF <sub>hex</sub> Entire device
4	UINT16	2	Error code	See table below
5	UINT8	1	More follows	00 <sub>hex</sub>
6	Visible String	51	Text	See table below

 The message with priority 81<sub>hex</sub> or 82<sub>hex</sub> is a one-off, internal message to the bus coupler. The bus coupler transfers this error message to the error mechanisms of the higher-level system.

 After the error has been eliminated, it is automatically reset.

Error and status of the local diagnostics and status indicators

Subindex	2	3	4	6	Text	LED					
Error	Priority	Channel/group/module	Error code	hex	hex	hex	D	U <sub>O</sub>	E1	E2	xx
	hex	hex	hex								
No error	00	00	0000			Status OK	●	●	○	○	○
Short-circuit/overload of an output	02	##	2344			Overload / short circuit DO##, terminal point \$\$	●	●	○	●	●
Failure of the supply for digital output modules (U <sub>O</sub> ) (Actuator supply not present)	01	FF	3422			Missing I/O supply UO, terminal point a1/a2, b1/b2	●	○	●	○	○

##	Channel number	xx LED	Diagnostics of the output
\$\$	Terminal point number	xx	00 ... 07, 10 ... 17, 20 ... 27, 30 ... 37, 40 ... 47, 50 ... 57, 60 ... 67, 70 ... 77
○	Off	●	Green on
●	On	●	Red on
		●	Flashing green/yellow

 "Actuator supply not present" is then signaled using object 0018<sub>hex</sub> and LED E1 if you have configured a setting stipulating that the error should be sent to the controller (see object FF8F<sub>hex</sub>).

### Deviating behavior up to index AB1

0018 <sub>hex</sub> : Diagnostics state (read)				
Subindex	Data type	Length in bytes	Meaning	Contents
0	Record	8	Diagnostic state	Complete diagnostics information
1	UINT16	2	Error number	0 ... 65535 <sub>dec</sub>
2	UINT8	1	Priority	00 <sub>hex</sub> No error
				01 <sub>hex</sub> Error
				02 <sub>hex</sub> Warning
				81 <sub>hex</sub> Error removed
				82 <sub>hex</sub> Warning eliminated
3	UINT8	1	Channel/group/module	00 <sub>hex</sub> No error
				FF <sub>hex</sub> Entire device
4	UINT16	2	Error code	See table below
5	UINT8	1	More follows	00 <sub>hex</sub>
6	Visible String	1	Text	00 <sub>hex</sub>

Error and status of the local diagnostics and status indicators

Subindex	2	3	4	LED			
Error	Priority	Channel/group/module	Error code	D		U <sub>O</sub>	E1
	hex	hex	hex	●	●	○	○
No error	00	00	0000	●	●	○	○
Short-circuit/overload of an output	02	00	2344	●	●	●	●
Failure of the supply for digital output modules (U <sub>O</sub> ) (Actuator supply not present)	01	FF	3422	● or ⚡	○	○	○

xx LED      Diagnostics of the output  
 xx      00 ... 07, 10 ... 17, 20 ... 27, 30 ... 37, 40 ...  
         47, 50 ... 57, 60 ... 67, 70 ... 77

○	Off	●	Green on
●	On	●	Red on
		⚡	Flashing green/yellow

The behavior of LED D during an "Actuator supply not present" error depends on whether you have switched error reporting via the FF8F<sub>hex</sub> object on or off.

Parameterization in FF8F <sub>hex</sub>	D LED
Do not report error to the controller	●
Report error to the controller	⚡

## 15 Application objects

In the case of valid parameters, the parameterization is stored in the module permanently.

Index (hex)	Object name	Data type	A	L	Rights	Meaning/contents
FF8D	PD Output Substitute Configuration	UINT8	1	1	R/W	Substitute value behavior
FF8F	DiagOut	UINT8	1	1	R/W	Message "Actuator supply not present"

### 15.1 Substitute value behavior (FF8D<sub>hex</sub>: PD Output Substitute Configuration)

With this object, you parameterize the behavior of the module so that an application reset can be detected if necessary.

FF8D <sub>hex</sub> : Substitute value behavior (read, write)				
Subindex	Data type	Length in bytes	Contents	
0	UINT8	1	00 <sub>hex</sub> (Default)	Set outputs to 0
			01 <sub>hex</sub>	Hold last value

### 15.2 Message "Actuator supply not present" (FF8F<sub>hex</sub>: DiagOut)

With this object, you parameterize whether the "Actuator supply missing" error is reported to the controller or not.

FF8F <sub>hex</sub> : Message "Actuator supply not present" (Read, write)				
Subindex	Data type	Length in bytes	Contents	
0	UINT8	1	00 <sub>hex</sub> (Default)	Do not report error to the controller
			01 <sub>hex</sub>	Report error to the controller

#### From index AC1

If you parameterize the module so that the error is not reported to the controller, the corresponding indicator in LED E1 (red on) is suppressed. The behavior of the LED D is not affected.

#### Deviating behavior up to index AB1

If you parameterize the module so that the error is not reported to the controller, the corresponding indicator in LED D (flashing green/yellow) is suppressed and the LED lights up green.

## 16 Device descriptions

The device is described in the device description files.  
These files are available for download at  
[www.boschrexroth.com/electrics](http://www.boschrexroth.com/electrics) in the download  
area of the bus coupler used.

DOK-CTRL-  
S20\*DO\*64\*1-DA02-EN-P      Bosch Rexroth AG  
Bgm.-Dr.-Nebel-Str. 2  
97816 Lohr a.Main  
Germany  
Tel. +49 9352 18 0  
Fax +49 9352 18 8400  
[www.boschrexroth.com/electrics](http://www.boschrexroth.com/electrics)

All rights reserved. No part of this document may be reproduced or stored, processed, duplicated, or circulated using electronic systems, in any form or by any means, without the prior written authorization of Bosch Rexroth AG, Electric Drives and Controls. Violations shall give rise to claims for damages. The data specified above only serve to describe the product. They do not indicate any specific condition or suitability for a certain application. It must be remembered that our products are subject to natural wear and ageing.