

Rexroth Inline Terminal With Eight Analog Input Channels

R911170484
Edition 02**R-IB IL AI 8/SF(-2MBD)-PAC**

8 analog inputs
2-wire technology
0 - 20 mA, 4 - 20 mA, ± 20 mA, 0 - 40 mA, ± 40 mA
0 - 5 V, ± 5 V, 0 - 10 V, ± 10 V, 0 - 25 V, ± 25 V, 0 - 50 V

05/2007



1 Description

The terminal is designed for use within an Inline station. It is used to acquire analog voltage or current signals.

Features

- Eight analog single-ended signal inputs for the connection of either voltage or current signals
- Connection of sensors in 2-wire technology
- Various current and voltage measuring ranges
- Channels are configured independently of one another using the bus system
- Measured values can be represented in five different formats
- 16-bit analog/digital converter
- Process data multiplex mode
- Diagnostic indicators



This data sheet is only valid in association with the application descriptions for the Rexroth Inline system (see ["Documentation" on page 4](#)).



Make sure you always use the latest documentation.
It can be downloaded at www.boschrexroth.com.

Table of Contents

1	Description	1
2	Ordering Data.....	4
3	Technical Data	4
4	Local Diagnostic and Status Indicators and Terminal Point Assignment	7
4.1	Local Diagnostic Indicators	7
4.2	Function Identification	7
4.3	Terminal Point Assignment for Each Connector	7
5	Installation Instructions	7
6	Internal Circuit Diagram	8
7	Electrical Isolation	9
8	Connection Notes	9
9	Connection Examples	9
9.1	Connection of Active Sensors	9
9.2	Connection of Passive Sensors	9
10	Programming Data/Configuration Data	10
10.1	Local Bus.....	10
10.2	Other Bus Systems	10
11	Process Data	10
11.1	Process Data Output Words for Configuring the Terminal (See page 11)	10
11.2	Process Data Input Words (See page 14)	10
12	Process Data Output Words OUT[0] and OUT[1].....	11
12.1	OUT[0] (Command Code)	12
12.2	OUT[1] (Parameter Word)	13
13	Process Data Input Words IN[0] and IN[1].....	14
13.1	IN[0] and IN[1] for Commands 0x00 _{hex} to 6000 _{hex}	14
13.2	IN[0] and IN[1] for Group Commands 7x00 _{hex}	16

14	Formats for the Representation of Measured Values.....	18
14.1	"IB IL" Format	18
14.2	"IB ST" Format	20
14.3	"IB RT" Format	22
14.4	"Standardized Representation" Format.....	24
14.5	Examples of Measured Value Representation in Various Data Formats	27
14.6	"PIO" Format	28
15	Process Data Input Words in the Event of an Error.....	29
16	Startup Options	30
16.1	Standard Method 1	30
16.2	Standard Method 2.....	33
16.3	Special Methods.....	35
16.4	Advantages of Standard Methods Over Special Methods.....	35
17	Application Notes.....	36
17.1	Precision DC Measurements.....	36
17.2	Closed-Loop Control Tasks.....	36
17.3	Signal Scanning or Fast, Sudden Signals	36
17.4	Linked Voltages.....	37
17.5	Current Loops.....	37
17.6	Passive Sensors.....	37
18	Tolerance and Temperature Response.....	38

2 Ordering Data

Products

Description	Type	MNR	Pcs./Pck.
Rexroth Inline terminal with eight analog input channels; complete with accessories (connectors and labeling fields); transmission speed of 500 kbps	R-IB IL AI 8/SF-PAC	R911308493	1
Rexroth Inline terminal with eight analog input channels; complete with accessories (connectors and labeling fields); transmission speed of 2 Mbps	R-IB IL AI 8/SF-2MBD-PAC	R911170430	1

Documentation

Description	Type	MNR	Pcs./Pck.
"Automation Terminals of the Rexroth Inline Product Range" application description	DOK-CONTRL-ILSYSINS***-AW...-EN-P	R911317021	1
"Configuring and Installing the Rexroth Inline Product Range for INTERBUS" application description	DOK-CONTRL-ILSYSPRO***-AW...-EN-P	R911317023	1



For additional ordering data (accessories), please refer to the product catalog at www.boschrexroth.com.

3 Technical Data

General Data

Housing dimensions (width x height x depth)	48.8 mm x 120 mm x 71.5 mm
Weight	213 g (with connectors)
Operating mode	Process data mode with 2 words
Connection method for sensors	2-wire technology
Ambient temperature (operation)	-25°C to +55°C
Ambient temperature (storage/transport)	-25°C to +85°C
Permissible humidity (operation/storage/transport)	10% to 95%, according to DIN EN 61131-2
Permissible air pressure (operation/storage/transport)	70 kPa to 106 kPa (up to 3000 m above sea level)
Degree of protection	IP20 according to IEC 60529
Protection class	Class 3 according to VDE 0106, IEC 60536
Connection data for Inline connector	
Connection method	Spring-cage terminals
Conductor cross-section	0.2 mm ² to 1.5 mm ² (solid or stranded), 24 - 16 AWG

Interface

Local bus	Data routing
-----------	--------------

Transmission Speed

R-IB IL AI 8/SF-PAC	500 kbps
R-IB IL AI 8/SF-2MBD-PAC	2 Mbps

Power Consumption

	500 kbps	2 Mbps
Communications power U_L	7.5 V DC	7.5 V DC
Current consumption from U_L	48 mA (typical)/ 55 mA (maximum)	68 mA (typical)/ 85 mA (maximum)
I/O supply voltage U_{ANA}	24 V DC	24 V DC
Current consumption at U_{ANA}	30 mA (typical)/ 35 mA (maximum)	24 mA (typical)/ 38 mA (maximum)
Total power consumption	1500 mW (typical)	1086 mW (typical)

Supply of the Module Electronics and I/O Through the Bus Coupler/Power Terminal

Connection method	Potential routing
-------------------	-------------------

Analog Inputs

Number	8 analog single-ended inputs
Signals/resolution in the process data word (quantization)	See tables in "Formats for the Representation of Measured Values" on page 18
Measured value representation	In the following formats: IB IL (15 bits with sign bit) IB ST (12 bits with sign bit) IB RT (15 bits with sign bit) Standardized representation (15 bits with sign bit) PIO (16 bits)



Please read the notes on [page 19](#) and [page 25](#) on measured value representation in "IB IL" and "standardized representation" format.

Digital filtering (mean-value generation)	None or over 4, 16 or 32 measured values Default setting: over 16 measured values
Conversion time of the A/D converter	10 µs, maximum
Process data update of the channels	Bus synchronous
Firmware runtime depending on the command	



The firmware runtime contains the times for the signal acquisition, signal conditioning, mean-value generation, standardization, and transfer of measured values to the process data register.

0x00 _{hex}	< 800 µs
5x00 _{hex}	< 850 µs
7000 _{hex} /7100 _{hex}	< 1500 µs
7400 _{hex} /7500 _{hex} /7600 _{hex} /7700 _{hex}	< 1300 µs

Analog Input Stages**Voltage Inputs**

Input resistance	240 kΩ, minimum
Characteristics of the input filters (input stage)	1st order
Limit frequency (-3 dB) of the input filters	3.5 kHz
Behavior on sensor failure	Goes to 0 V
Maximum permissible voltage between analog voltage inputs and an analog reference potential or between two voltage inputs	50 V

Current Inputs

Input resistance	25 Ω (shunt)
Limit frequency (-3 dB) of the input filters	3.5 kHz
Behavior on sensor failure	Goes to 0 mA or 4 mA
Maximum permissible voltage between analog current inputs and an analog reference potential or between two current inputs	±2.5 V (corresponds to 100 mA via the shunts)
Maximum permissible current in every input	±100 mA

Safety Equipment

Surge voltage and overcurrents	100% overload, maximum
--------------------------------	------------------------

Electrical Isolation/Isolation of the Voltage Areas**CAUTION**

To provide electrical isolation between the logic level and the I/O area, it is necessary to supply the station bus coupler and the sensors connected to the analog input terminal described here from separate power supply units. Interconnection of the power supply units in the 24 V area is not permitted.

Common Potentials

The 24 V main voltage, 24 V segment voltage, and GND have the same potential. FE is a separate potential area.

Separate Potentials in the System Consisting of Bus Coupler/Power Terminal and I/O Terminal**- Test Distance**

5 V supply incoming remote bus/
7.5 V supply (bus logic)

5 V supply outgoing remote bus/
7.5 V supply (bus logic)

7.5 V supply (bus logic)/24 V supply U_{ANA} /
I/O

7.5 V supply (bus logic), 24 V supply U_{ANA} /
functional earth ground

I/O/functional earth ground

- Test Voltage

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.

500 V AC, 50 Hz, 1 min.

Error Messages to the Higher-Level Control or Computer System

Failure of the voltage supply U_{ANA}

Yes

Peripheral fault/user error

Yes, error message via the process data input words (see
page 29)

Approvals

For the latest approvals, please visit www.boschrexroth.com.

4 Local Diagnostic and Status Indicators and Terminal Point Assignment

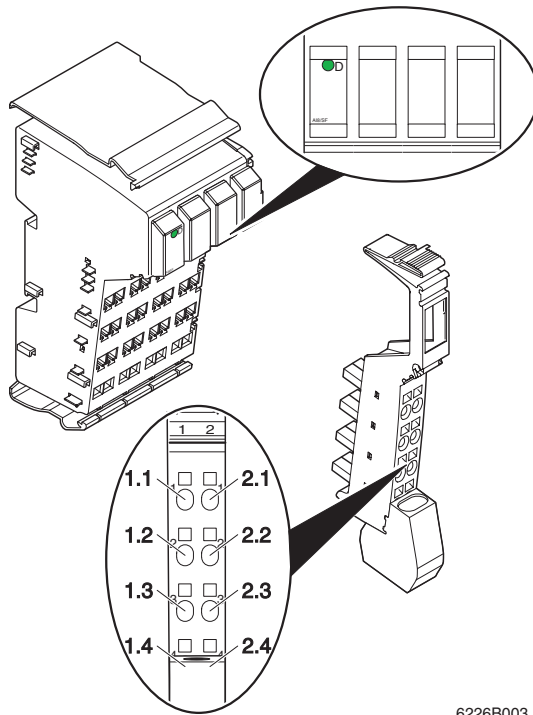


Fig. 1 Terminal with one of the appropriate connectors

4.1 Local Diagnostic Indicators

Des.	Color	Meaning
D	Green	Diagnostics

4.2 Function Identification

Green

2 Mbps: White stripe in the vicinity of the D LED

4.3 Terminal Point Assignment for Each Connector

Terminal Points	Signal	Assignment
1.1	+U1	Voltage input channel 1
2.1	+U2	Voltage input channel 2
1.2	+I1	Current input channel 1
2.2	+I2	Current input channel 2
1.3, 2.3	-1, -2	Minus input (for both current and voltage)
1.4, 2.4	Shield	Shield connection

5 Installation Instructions


High current flowing through potential jumpers U_M and U_S leads to a temperature rise in the potential jumpers and inside the terminal. Observe the following instructions to keep the current flowing through the potential jumpers of the analog terminals as low as possible:



CAUTION

Create a separate main circuit for the analog terminals

If this is not possible in your application and if you are using analog terminals in a main circuit together with other terminals, place the analog terminals after all the other terminals at the end of the main circuit.

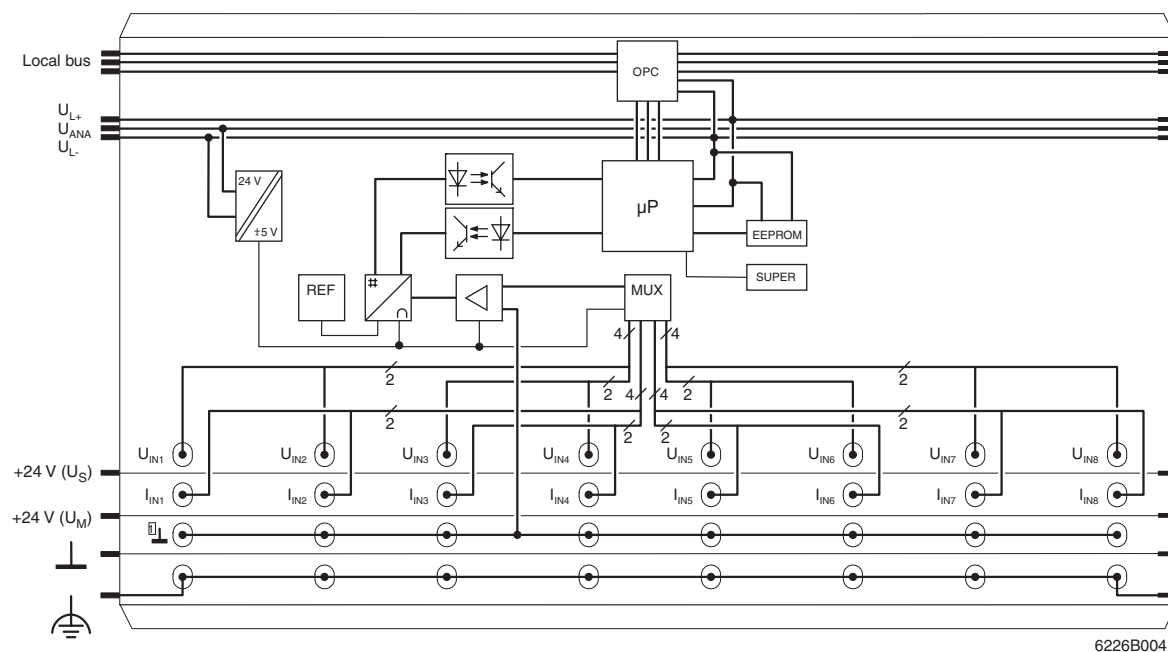

Other symbols used are explained in the DOK-CONTRL-ILSYSINS***-AW..-EN-P application description or the application description for your bus system.

7 Electrical Isolation

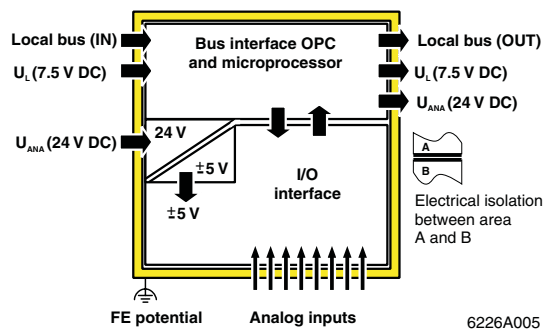


Fig. 3 Electrical isolation of the individual function areas

8 Connection Notes



CAUTION

Do not simultaneously apply current and voltage signals to **one** input channel as you will not receive valid measured values.



CAUTION

Do not connect voltages above ± 2.5 V to a current input. The module electronics will be damaged, as the maximum permissible current of ± 100 mA will be exceeded.



Always connect the analog sensors using shielded, twisted pair cables. Connect the shielding to the Inline terminal using the shield connection clamp. The clamp connects the shield directly to FE on the terminal side. Additional wiring is not required. Isolate the shielding at the sensor or connect it with a high resistance and a capacitor to the PE potential.

9 Connection Examples



Observe the connection notes on [page 9](#).

Fig. 4 shows the connection schematically (without shield connector).

9.1 Connection of Active Sensors

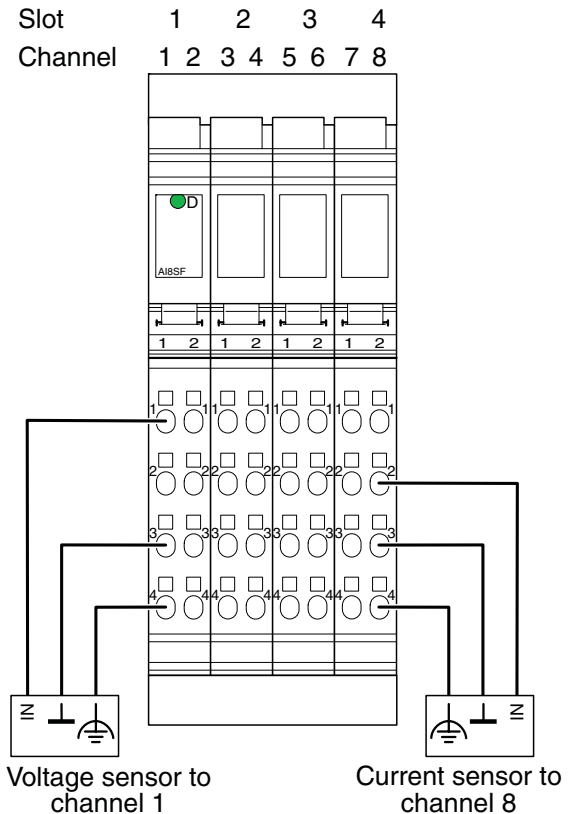


Fig. 4 Connection of active sensors using 2-wire technology with shield connection



CAUTION

The sensors have the same reference potential.

9.2 Connection of Passive Sensors



The R-IB IL AI 8/IS-PAC terminal is used to connect passive current sensors.

10 Programming Data/ Configuration Data

10.1 Local Bus

ID code	5F _{hex} (95 _{dec})
Length code	02 _{hex}
Process data channel	32 bits
Input address area	2 words
Output address area	2 words
Parameter channel (PCP)	0 bytes
Register length (bus)	2 words

10.2 Other Bus Systems



For the configuration data of other bus systems, please refer to the corresponding electronic device data sheet (e.g., GSD, EDS).

11 Process Data

11.1 Process Data Output Words for Configuring the Terminal (See [page 11](#))

Process data output word 0 (OUT[0])								Process data output word 1 (OUT[1])									
Bit 15				Bit 0				Bit 15				Bit 0					
(Word.bit) view	Word	OUT[0]															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Assignment	0	Command						0	0	0	0	0	0	0	0	0
(Word.bit) view	Word	OUT[1]															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Assignment	0	0	0	0	0	0	Filter	0	Format			Measuring range				

11.2 Process Data Input Words (See [page 14](#))

Process data input word 0 (IN[0])								Process data input word 1 (IN[1])									
Bit 15				Bit 0				Bit 15				Bit 0					
(Word.bit) view	Word	IN[0]															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Assignment	Depends on the command															
(Word.bit) view	Word	IN[1]															
	Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Assignment	Depends on the command															

12 Process Data Output Words OUT[0] and OUT[1]

The terminal must be configured using the two process data output words. Word OUT[0] contains the command and word OUT[1] contains the parameters for this command.

The following configurations are possible:

- Selecting a measuring range according to the input signal
- Selecting mean-value generation (filtering)
- Changing the formats for the representation of measured values



Current or voltage measurement is selected by applying the measured signal to the current or voltage input and then configuring the measuring range.



After applying voltage (power up) to the Inline station, the message "Measured value invalid" (diagnostic code 8004_{hex}) appears in the process data input words for every channel requested. The message is displayed until the corresponding channel has been configured.

If the configuration is changed, the message "Measured value invalid" (diagnostic code 8004_{hex}) appears for a maximum of 100 ms.



Please note the extended runtime when a channel is configured for the first time and every time a channel is reconfigured.

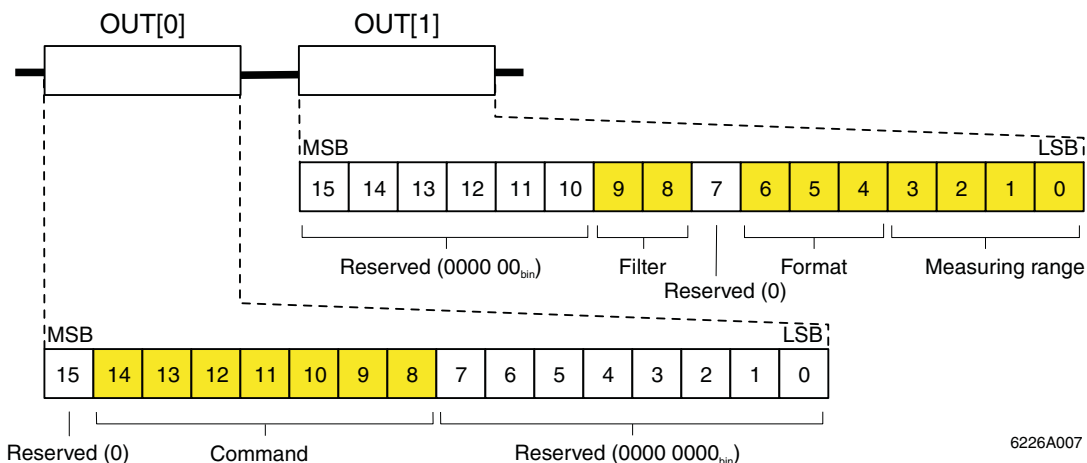


Fig. 5 Process data output words

MSB Most significant bit

LSB Least significant bit



Set all reserved bits to 0.

6226A007

12.1 OUT[0] (Command Code)

		OUT[0]															
Bit		15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment		0	Command							0	0	0	0	0	0	0	0

Bit 15 to bit 8 (command):

Bit 15 to Bit 8								OUT[0]	Command Function
0	0	0	0	0	Z ₂	Z ₁	Z ₀	0x00 _{hex}	Read measured value of channel x
0	0	0	1	0	Z ₂	Z ₁	Z ₀	1x00 _{hex}	Read configuration of channel x
0	0	1	1	1	1	0	0	3C00 _{hex}	Read firmware version and module ID
0	1	0	0	0	Z ₂	Z ₁	Z ₀	4x00 _{hex}	Configure channel x
0	1	0	1	0	Z ₂	Z ₁	Z ₀	5x00 _{hex}	Configure channel x and read measured value of channel x
0	1	1	0	0	0	0	0	6000 _{hex}	Configure entire terminal (all channels)
0	1	1	1	0	Y ₂	Y ₁	Y ₀	7x00 _{hex}	Commands for groups without mirroring

Z₂ Z₁ Z₀ Channel numberY₂ Y₁ Y₀ Group number

	OUT[0]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	Command							0	0	0	0	0	0	0	0
Channel/group	0	X	X	X	X	X	X	X	0	0	0	0	0	0	0	0

Bit 10 to bit 8 (channel number Z₂Z₁Z₀ or group number Y₂Y₁Y₀):

Code		Channel
bin	dec	
000	0	1
001	1	2
010	2	3
011	3	4
100	4	5
101	5	6
110	6	7
111	7	8

Code		Group
bin	dec	
000	0	4 x 8-bit group A (channel 1, 2, 3, and 4)
001	1	4 x 8-bit group B (channel 5, 6, 7, and 8)
010	2	Reserved
011	3	Reserved
100	4	2 x 16-bit group A (channel 1 and 2)
101	5	2 x 16-bit group B (channel 3 and 4)
110	6	2 x 16-bit group C (channel 5 and 6)
111	7	2 x 16-bit group D (channel 7 and 8)

12.2 OUT[1] (Parameter Word)

The parameters for commands 4x00_{hex}, 5x00_{hex}, and 6000_{hex} must be specified in OUT[1]. This parameter word is only evaluated for these commands.

Bit	OUT[1]															
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	0	0	0	0	0	Filter		0	Format			Measuring range			



If invalid parameters are specified in the parameter word, the command will not be executed. The command is acknowledged in the input words with the set error bit.

Bit 9 and bit 8:

Code		Filter (Filtering by Mean-Value Generation)
bin	dec	
00	0	16-sample average value (default)
01	1	No mean-value generation
10	2	4-sample average value
11	3	32-sample average value

Bit 6 to bit 4:

Code		Format
bin	dec	
000	0	IB IL (15 bits) (default)
001	1	IB ST (12 bits)
010	2	IB RT (15 bits)
011	3	Standardized representation
100	4	PIO (for the 4 mA to 20 mA range only)
101	5	Reserved
110	6	
111	7	

Bit 3 to bit 0:

Code		Measuring Range (Voltage)
bin	dec	
0000	0	0 V to 10 V (default)
0001	1	±10 V
0010	2	0 V to 5 V
0011	3	±5 V
0100	4	0 V to 25 V
0101	5	±25 V
0110	6	0 V to 50 V
0111	7	Reserved

Code		Measuring Range (Current)
bin	dec	
1000	8	0 mA to 20 mA
1001	9	±20 mA
1010	10	4 mA to 20 mA
1011	11	Reserved
1100	12	0 mA to 40 mA
1101	13	±40 mA
1110	14	Reserved
1111	15	Reserved



CAUTION


The differential voltage between different terminal inputs must not exceed 50 V.

If, for example, the 0 V to 50 V range is used on one channel, the use of bipolar ranges is **not permitted** on any other channel.

13 Process Data Input Words IN[0] and IN[1]

The measured values and diagnostic messages (diagnostic codes) are transmitted to the controller board or computer using the two process data input words. The contents of the words vary according to the command.

13.1 IN[0] and IN[1] for Commands 0x00_{hex} to 6000_{hex}

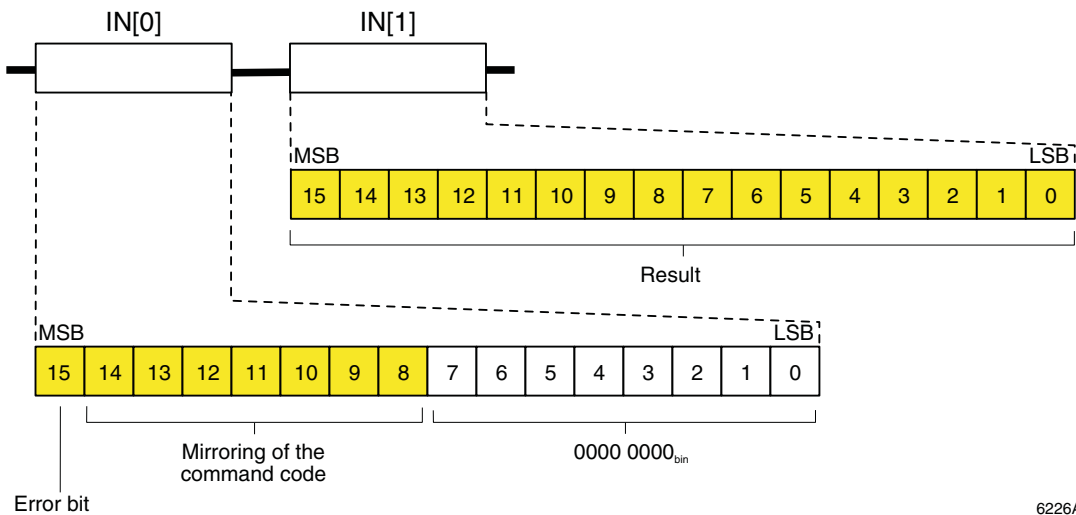

6226A008

Fig. 6 Process data input words

IN[0]

Output word OUT[0], which contains the command code, is mirrored in input word IN[0]. This confirms that the command has been executed correctly. If the command was not executed correctly, the error bit is set in bit 15 of input word IN[0].

The error bit is set for one of the following reasons (see also [page 29](#)):

- There is no valid configuration for the requested channel
- There was an invalid parameter during configuration
- A reserved bit was set

The command is only mirrored if it has been executed completely. This means, for example, that command 5x00_{hex} is only mirrored after the value has been read and not following reconfiguration.

IN[1]

Input word IN[1] varies depending on the command.

IN[1] contains the firmware version and module ID for command 3C00_{hex}.

Bit	IN[1]															
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Firmware version												Module ID			
	Example: 123 _{hex} : Terminal equipped with firmware Version 1.23												6 _{hex} : R-IB IL AI 8/SF			
Assignment													3 _{hex} : R-IB IL AI 8/IS			

For commands 1x00_{hex}, 4x00_{hex}, and 6000_{hex}, IN[1] contains the mirroring of the specified configuration.

	IN[1]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	0	0	0	0	0	Filter		0	Format			Measuring range			

For commands 0x00_{hex} and 5x00_{hex}, IN[1] contains the analog measured value.

Bit	IN[1]															
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
	Measured value in the corresponding format															
Assignment																

MSB															LSB		Format: IB IL IB RT Standardized representation
15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0		
SB	AV																

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	IB ST
SB	AV												0/4	OC	OR	

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0	PIO
AV																

6226A010

13.2 IN[0] and IN[1] for Group Commands 7x00_{hex}

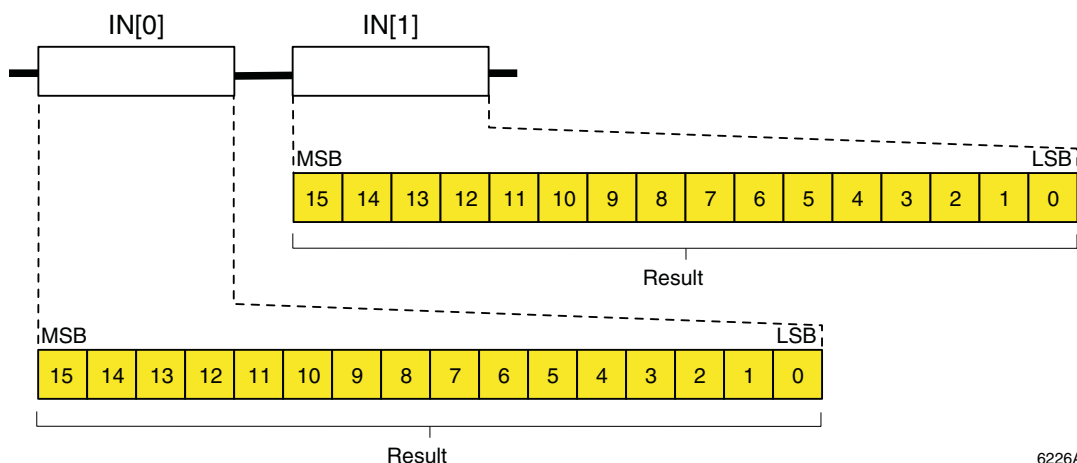


Fig. 8 Process data input words

6226A013

For group commands 7x00_{hex}, both input words contain the measured values of the channels that correspond to the group command.

Group Commands for Two 16-Bit Channels:

7400_{hex}, 7500_{hex}, 7600_{hex}, and 7700_{hex}

With commands for two 16-bit channels, the analog value of one channel is mapped to every input word. The representation corresponds to the representation in input word IN[1] for commands 0x00_{hex} and 5x00_{hex}.

Example 2 x 16-Bit Group A (Channels 1 and 2): Command 7400_{hex}

	IN[0]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	16-bit measured value channel 1 in the corresponding format															

	IN[1]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	16-bit measured value channel 2 in the corresponding format															

Group Commands for Four 8-Bit Channels: 7000_{hex} and 7100_{hex}

With commands for four channels, the analog values for two channels are mapped to every input word. The measured value for each channel is represented in eight bits. This measured value corresponds to bits 15 to 8 in the format representations of a 16-bit value.

Example 4 x 8-Bit Group A (Channels 1, 2, 3, and 4): Command 7000_{hex}

	IN[0]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	8-bit measured value channel 1 in the corresponding format								8-bit measured value channel 2 in the corresponding format							

	IN[1]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	8-bit measured value channel 3 in the corresponding format								8-bit measured value channel 4 in the corresponding format							



The status bits in "IB ST" format and the diagnostic messages in "IB IL" and "standardized representation" format are not displayed in this configuration.

14 Formats for the Representation of Measured Values

To ensure that the terminal can be operated in previously used data formats, the measured value representation can be switched to different formats. "IB IL" format is the default.

Abbreviations used in the following tables:

OR Overrange
UR Underrange

14.1 "IB IL" Format

The measured value is represented in bits 14 to 0. An additional bit (bit 15) is available as a sign bit.

This format supports extended diagnostics. Values $> 8000_{\text{hex}}$ and $< 8100_{\text{hex}}$ indicate an error.

The following diagnostic codes are possible:

Code (hex)	Error
8001	Overrange
8002	Open circuit
8004	Measured value invalid/no valid measured value available (e.g., because the channel has not been configured)
8010	Invalid configuration
8020	I/O supply voltage faulty
8040	Module faulty
8080	Underrange

Measured value representation in "IB IL" format (15 bits):

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
SB	Analog value														

SB Sign bit

Significant Measured Values

Voltage Ranges

Input Data Word (Two's Complement)		0 V to 5 V U_{IN}	0 V to 10 V U_{IN}	0 V to 25 V U_{IN}	0 V to 50 V U_{IN}
hex	dec	V	V	V	V
8001	OR	> +5.419	> +10.837	> +27.093	> +54.187
7F00	32512	+5.419	+10.837	+27.093	+54.187
7530	30000	+5.0	+10.0	+25.0	+50.0
0001	1	+166.67 μ V	+333.33 μ V	+833.33 μ V	+1.6667 mV
0000	0	0	0	0	0
0000	0	< 0	< 0	< 0	< 0

Input Data Word (Two's Complement)		± 5 V U_{IN}	± 10 V U_{IN}	± 25 V U_{IN}
hex	dec	V	V	V
8001	OR	> +5.419	> +10.837	> +27.093
7F00	32512	+5.419	+10.837	+27.093
7530	30000	+5.0	+10.0	+25.0
0001	1	+166.67 μ V	+333.33 μ V	+833.33 μ V
0000	0	0	0	0
FFFF	0	-166.67 μ V	-333.33 μ V	-833.33 μ V
8AD0	-30000	-5.0	-10.0	-25.0
8100	-32512	-5.419	-10.837	-27.093
8080	UR	< -5.419	< -10.837	< -27.093

Current Ranges:

Input Data Word (Two's Complement)		0 mA to 20 mA I_{IN}	0 mA to 40 mA I_{IN}
hex	dec	mA	mA
8001	OR	> +21.6746	> +43.3493
7F00	32512	+21.6746	+43.3493
7530	30000	+20.0	+40.0
0001	1	+0.66667 μ A	+1.3333 μ A
0000	0	0	0
0000	0	< 0	< 0

Input Data Word (Two's Complement)		4 mA to 20 mA I_{IN}
hex	dec	mA
8001	OR	> +21.339733
7F00	32512	+21.339733
7530	30000	+20.0
0001	1	+4.00053333
0000	0	+4.0 to 3.2
8002	Open circuit	< +3.2

Input Data Word (Two's Complement)		± 20 mA I_{IN}	± 40 mA I_{IN}
hex	dec	mA	mA
8001	OR	> +21.6746	> +43.3493
7F00	32512	+21.6746	+43.3493
7530	30000	+20.0	+40.0
0001	1	+0.6667 μ A	+1.3333 μ A
0000	0	0	0
FFFF	-1	-0.6667 μ A	-1.3333 μ A
8AD0	-30000	-20.0	-40.0
8100	-32512	-21.6746	-43.3493
8080	UR	< -21.6746	< -43.3493

14.2 "IB ST" Format

The measured value is represented in bits 14 to 3.

The remaining 4 bits are sign, measuring range, and error bits. This format corresponds to the data format used on INTERBUS ST modules.

Measured value representation in "IB ST" format (12 bits):

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
SB	Analog value												0/4	OC	OR

SB Sign bit

OC Open circuit

0/4 Measuring range 4 to 20 mA

OR Over/underrange

Significant Measured Values

Voltage Ranges

Input Data Word (Two's Complement)		0 V to 5 V U_{IN}	0 V to 10 V U_{IN}	0 V to 25 V U_{IN}	0 V to 50 V U_{IN}
hex	dec	V	V	V	V
7FF9	32761	> +5.375	> +10.75	> +26.875	> +53.75
7FF8	32760	+4.9988 to +5.375	+9.9975 to +10.75	+24.9939 to +26.875	+49.9878 to +53.75
4000	16384	+2.5	+5.0	+12.5	+25.0
0008	8	1.221 mV	+2.441 mV	6.1025 mV	+12.205 mV
0000	0	< 0	< 0	< 0	< 0

Input Data Word (Two's Complement)		± 5 V U_{IN}	± 10 V U_{IN}	± 25 V U_{IN}
hex	dec	V	V	V
7FF9	32761	> +5.375	> +10.75	> +26.875
7FF8	32760	+4.9988 to +5.375	+9.9975 to +10.75	+24.9939 to +26.875
4000	16384	+2.5	+5.0	+12.5
0008	8	+1.221 mV	+2.441 mV	+6.104 mV
0000	0	0	0	0
FFF8	-8	-1.221 mV	-2.441 mV	-6.104 mV
C000	-16384	-2.5	-5.0	-12.5
8000	-32768	-5.0 to -5.375	-10.00 to -10.75	-25.0 to -26.875
8001	-32767	<-5.375	< -10.75	<-26.875

Current Ranges:

Input Data Word (Two's Complement)		0 mA to 20 mA I_{IN}	0 mA to 40 mA I_{IN}
hex	dec	mA	mA
7FF9	32761	> +21.5	> +43.0
7FF8	32760	+19.9951 to +21.5	+39.9902 to +43.0
4000	16384	+10.0	+20.0
0008	8	+4.8828 μ A	+9.7656 μ A
0000	0	< 0	< 0

Input Data Word (Two's Complement)		± 20 mA I_{IN}	± 40 mA I_{IN}
hex	dec	mA	mA
7FF9	32761	> +21.5	> +43.0
7FF8	32760	+19.9951 to +21.5	+39.9902 to +43.0
4000	16384	+10.0	+20.0
0008	8	+4.8828 μ A	+9.7656 μ A
0000	0	0	0
FFF8	-8	-4.8828 μ A	-9.7656 μ A
C000	-16384	-10.0	-20.0
8000	-32768	-20.0 to -21.5	-40.0 to -43.0
8001	-32767	< -21.5	< -43.0

Input Data Word (Two's Complement)		4 mA to 20 mA I_{IN}
hex	dec	mA
7FFD	32765	> +21.5
7FFC	32764	+19.9961 to +21.5
4000	16384	+10
000C	12	+4.003906
0004	4	+3.2 to +4.0
0006	6	< 3.2

14.3 "IB RT" Format

The measured value is represented in bits 14 to 0. An additional bit (bit 15) is available as a sign bit.

This format corresponds to the data format used on INTERBUS RT modules.

Diagnostic codes and error bits are not defined in this data format. An open circuit is indicated by the positive final value $7FFF_{\text{hex}}$.

Measured value representation in "IB RT" format (15 bits):

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
SB	Analog value														

SB Sign bit

Significant Measured Values

Voltage Ranges

Input Data Word (Two's Complement)		0 V to 5 V U_{IN}	0 V to 10 V U_{IN}	0 V to 25 V U_{IN}	0 V to 50 V U_{IN}
hex	dec	V	V	V	V
7FFF	32767	$\geq +4.999847$	$\geq +9.999695$	$\geq +24.999237$	$\geq +49.998474$
7FFE	32766	$+4.999695$	$+9.999390$	$+24.998474$	$+49.996948$
4000	16384	+2.5	+5	+12.5	+25.0
0001	1	$+152.6 \mu\text{V}$	$+305.2 \mu\text{V}$	$+762.9 \mu\text{V}$	$+1.5259 \text{ mV}$
0000	0	0	0	0	0

Input Data Word (Two's Complement)		$\pm 5 \text{ V}$ U_{IN}	$\pm 10 \text{ V}$ U_{IN}	$\pm 25 \text{ V}$ U_{IN}
hex	dec	V	V	V
7FFF	32767	$\geq +4.999847$	$\geq +9.999695$	$\geq +24.999237$
7FFE	32766	$+4.999695$	$+9.999390$	$+24.998474$
4000	16384	+2.5	+5.0	+12.5
0001	1	$+152.6 \mu\text{V}$	$+305.2 \mu\text{V}$	$+762.9 \mu\text{V}$
0000	0	0	0	0
FFFF	-1	$-152.6 \mu\text{V}$	$-305.2 \mu\text{V}$	$-762.9 \mu\text{V}$
C000	-16384	-2.5	-5.0	-12.5
8001	-32767	-4.999847	-9.999695	-24.999237
8000	-32768	≤ -5.0	≤ -10.0	≤ -25.0

Current Ranges:

Input Data Word (Two's Complement)		0 mA to 20 mA I_{IN}	0 mA to 40 mA I_{IN}
hex	dec	mA	mA
7FFF	32767	$\geq +19.9993896$	$\geq +39.9987793$
7FFE	32766	$+19.9987793$	$+39.9975586$
4000	16384	+10	+20
0001	1	$+0.6104 \mu A$	$+1.2207 \mu A$
0000	0	0	0

Input Data Word (Two's Complement)		± 20 mA I_{IN}	± 40 mA I_{IN}
hex	dec	mA	mA
7FFF	32767	$\geq +19.999385$	$\geq +39.9987739$
7FFE	32766	$+19.998779$	$+39.9975586$
4000	16384	+10.0	+20.0
0001	1	$+0.6104 \mu A$	$+1.2207 \mu A$
0000	0	0	0
FFFF	-1	-0.0006105	-0.0012207
C000	-16384	-10.0	-20.0
8001	-32770	-19.999385	-39.9987793
8000	-32768	≤ -20.0	≤ -40.0

Input Data Word (Two's Complement)		4 mA to 20 mA I_{IN}
hex	dec	mA
7FFF	32767	$\geq +19.9995117$
7FFE	32766	$+19.9990234$
4000	16384	+12
0001	1	$+4.0004884$
0000	0	+4.0
0000	0	$+3.2$ to $+4.0$
7FFF	32767	$< +3.2$

14.4 "Standardized Representation" Format

The data is represented in bits 14 to 0. An additional bit (bit 15) is available as a sign bit.

In this format, data is standardized to the measuring range and represented in such a way that it indicates the corresponding value without conversion.

In this format, **one bit** has the following validity for the measuring ranges stated:

Measuring Range	Validity of One Bit
0 V to 5 V; ±5 V	1 mV
0 V to 10 V; ±10 V	1 mV
0 V to 25 V; ±25 V	1 mV
0 V to 50 V	10 mV
0 mA to 20 mA; 4 mA to 20 mA	1 µA
0 mA to 40 mA	10 µA

This format supports extended diagnostics. Values > 8000_{hex} and < 8100_{hex} indicate an error.

The following diagnostic codes are possible:

Code (hex)	Error
8001	Overrange
8002	Open circuit
8004	Measured value invalid/no valid measured value available (e.g., because the channel has not been configured)
8010	Invalid configuration
8020	I/O supply voltage faulty
8040	Module faulty
8080	Underrange

Measured value representation in "standardized representation" format (15 bits):

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
SB	Analog value														

SB Sign bit

Significant Measured Values

Voltage Ranges

Input Data Word (Two's Complement)		0 V to 5 V U_{IN}	0 V to 50 V U_{IN}	± 5 V U_{IN}
hex	dec	V	V	V
8001	OR	> +5.419	> +54.187	> +5.419
152B	5419	+5.419	+54.187	+5.419
1388	5000	+5.0	+50.0	+5.0
0001	1	+1.0 mV	+10.0 mV	+1.0 mV
0000	0	0	0	0
0000	-1	< 0	< 0	-1.0 mV
EC78	-5000	–	–	-5.0
EAD5	-5419	–	–	-5.419
8080	UR	–	–	< -5.419

Input Data Word (Two's Complement)		0 V to 10 V U_{IN}	± 10 V U_{IN}
hex	dec	V	V
8001	OR	> +10.837	> +10.837
2A55	10837	+10.837	+10.837
2710	10000	+10.0	+10.0
0001	1	+1.0 mV	+1.0 mV
0000	0	0	0
0000	0	< 0	–
FFFF	-1	–	-1.0 mV
D8F0	-10000	–	-10.0
D5AB	-10837	–	-10.837
8080	UR	–	< -10.837

Input Data Word (Two's Complement)		0 V to 25 V U_{IN}	± 25 V U_{IN}
hex	dec	V	V
8001	OR	> +27.093	> +27.093
69D5	27093	+27.093	+27.093
61A8	25000	+25.0	+25.0
0001	1	+1.0 mV	+1.0 mV
0000	0	0	0
0000	0	< 0	–
FFFF	-1	–	-1.0 mV
9E58	-25000	–	-25.0
962B	-27093	–	-27.093
8080	UR	–	< -27.093

Current Ranges:

Input Data Word (Two's Complement)		0 mA to 20 mA I_{IN}
hex	dec	mA
8001	OR	> +21.6747
54AA	21674	+21.6747
4E20	20000	+20.0
0001	1	+1.0 μ A
0000	0	0
0000	0	< 0

Input Data Word (Two's Complement)		4 mA to 20 mA I_{IN}
hex	dec	mA
8001	OR	> +21.339
43BB	17339	+21.339
3E80	16000	+20.0
0001	1	+4.001
0000	0	+4.0 to +3.2
8002	Open circuit	< +3.2

Input Data Word (Two's Complement)		0 mA to 40 mA I_{IN}
hex	dec	mA
8001	OR	> +43.3493
10EE	4334	+43.3493
0FA0	4000	+40.0
0001	1	+10.0 μ A
0000	0	0
0000	0	< 0

Input Data Word (Two's Complement)		± 20 mA I_{IN}
hex	dec	mA
8001	OR	\geq +21.6747
54AA	21674	+21.6747
4E20	20000	+20.0
0001	1	+1.0 μ A
0000	0	0
FFFF	-1	-0.001
B1E0	-20000	-20.0
AB56	-21674	-21.6747
8080	UR	< -21.6747

Input Data Word (Two's Complement)		± 40 mA I_{IN}
hex	dec	mA
8001	OR	> +43.349
10EE	4334	+43.349
0FA0	4000	+40.0
0001	1	+10.0 μ A
0000	0	0
FFFF	-1	-10.0 μ A
F060	-4000	-40.0
EF12	-4334	-43.349
8080	UR	< -43.349

14.5 Examples of Measured Value Representation in Various Data Formats

Measuring range: 0 mA to 20 mA

Measured value: 10 mA

Input data word:

Format	hex Value	dec Value	Measured Value
IB IL	3A98	15,000	10 mA
IB ST	4000	16,384	10 mA
IB RT	4000	16,384	10 mA
Standardized representation	2710	10,000	10 mA

Measuring range: ± 10 V

Measured value: +5 V

Input data word:

Format	hex Value	dec Value	Measured Value
IB IL	3A98	15,000	5 V
IB ST	4000	16,384	5 V
IB RT	4000	16,384	5 V
Standardized representation	1388	5000	5 V

14.6 "PIO" Format

PIO format enables high-resolution representation of measured values in the 4 mA to 20 mA current measuring range. In this format, a hypothetical measuring range of 0 mA to 25 mA is divided into 2^{16} quantization steps (65,536 steps). Thus, unipolar measured currents with a resolution of $0.38 \mu\text{A}/\text{LSB}$ can be represented. Although this format is designed for the 4 mA to 20 mA range, signals between 0 mA and 24 mA can be acquired so the overrange limits and the open circuit threshold in the higher-level control system can be freely defined.

Measured value representation in "PIO" format (16 bits):

15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Analog value															

Example of Parameterization Using PIO Format

Channel: 1
 Filtering: 16-sample average value
 Format: PIO
 Measuring range: 4 mA to 20 mA (PIO format is only supported in this measuring range)

Option 1:

1 Configure channel 1

OUT[0] 4000_{hex}

OUT[1] 004A_{hex}

2 Read the measured value

OUT[0] 0000_{hex}

OUT[1] 0000_{hex}

Option 2:

Configure channel 1 and read the measured value

OUT[0] 5000_{hex}

OUT[1] 004A_{hex}

Significant Measured Values

Input Data Word (Two's Complement)		PIO I _{IN}
hex	dec	mA
F5C2	62914	+24.0
CCCD	52429	+20.0
6666	26214	+10.0
0A3D	2621	+1.0
0001	1	+0.3815 μA
0000	0	+0

15 Process Data Input Words in the Event of an Error

In the event of an error, the command is mirrored in input word IN[0] and displayed with the set error bit. Input word IN[1] indicates the error cause.

The following diagnostic codes are valid for configuration or hardware errors **in all data formats**:

Command (hex)	Code (hex)	PF	Meaning/Note	Remedy
	8020	X	I/O supply voltage faulty.	<ul style="list-style-type: none"> Check the supply voltage of the station head (e.g., U_{BC}). Check the potential jumper connection.
After module start	8040	X	Module faulty.	Replace module.
0x00	8004		There is no valid configuration for the requested channel.	Configure channel.
5x00	8004		The configuration just specified is invalid.	Check and correct configuration.
1x00	8010		There is no valid configuration for the requested channel.	Configure channel.
4x00 and 6000			The parameters are mirrored. This is usually caused by invalid parameters.	Check and correct parameters.
3C00			No diagnostic code.	

PF A peripheral fault is reported to the higher-level control system

In addition to the indicator in the input words, for diagnostic codes 8040_{hex} (module faulty) and 8020_{hex} (I/O supply voltage faulty), a peripheral fault is reported to the higher-level control system.



The "IB IL" and "standardized representation" formats offer additional diagnostic functions. These are specified on [page 18](#) and [page 24](#).

16 Startup Options

The following startup options illustrate how to use the terminal.

16.1 Standard Method 1

Task:

- **All input channels** are to be operated in the **same** configuration (6000_{hex})
- Filtering by mean-value generation: 32-sample average value (11_{bin}, 3_{dec})
- Format: IB IL (000_{bin}, 0_{dec})
- Measuring range: ± 10 V (0001_{bin}, 1_{dec})

Procedure:

- 1 Install the terminal.
- 2 Connect the voltage (power up).
- 3 Configure the terminal (initialization phase, e.g., in the initialization phase of the application program).
- 4 Read the measured value for each channel in turn.

Initialization Phase:

According to the task, the process data output words appear as follows:

	OUT[0]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	Command							0	0	0	0	0	0	0	0
bin	0	1	1	0	0	0	0	0	0	0	0	0	0	0	0	0
hex	6				0				0				0			

	OUT[1]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	0	0	0	0	0	Filter		0	Format			Measuring range			
bin	0	0	0	0	0	0	1	1	0	0	0	0	0	0	0	1
hex	0				3				0				1			

With the command in OUT[0], the configuration according to OUT[1] is sent to the module electronics. After configuration is complete, the command and the configuration are mirrored in the process data input words.

Configure terminal:	OUT[0]:	6000 _{hex}	OUT[1]:	0301 _{hex}
Configuration completed successfully:	IN[0]	6000 _{hex}	IN[1]:	0301 _{hex}
Error during configuration:	IN[0]	E000 _{hex}	IN[1]:	0301 _{hex}

A **cyclic program sequence, which reads the measured values of the individual channels**, takes place after configuration has been successfully completed.

Process data output word OUT[0] appears as follows:

Bit	OUT[0]															
	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	Command							0	0	0	0	0	0	0	0
bin	0	0	0	0	0	Z ₂	Z ₁	Z ₀	0	0	0	0	0	0	0	0
hex	0				x				0				0			

Command 0x00_{hex} does not require any parameters and the value of parameter word OUT[1] is 0000_{hex}.


With the command in OUT[0], the read request is sent to the module electronics. After the command has been executed, it is mirrored in process data input word IN[0] and the analog value (xxxx_{hex}) or a diagnostic message (yyyy_{hex}) is displayed in process data input word IN[1].

Read measured value for channel 1:	OUT[0]:	0000 _{hex}	OUT[1]:	0000 _{hex}
Command executed successfully:	IN[0]	0000 _{hex}	IN[1]:	xxxx _{hex}
Error during execution:	IN[0]	8000 _{hex}	IN[1]:	yyyy _{hex}

Read measured value for channel 2:	OUT[0]:	0100 _{hex}	OUT[1]:	0000 _{hex}
Command executed successfully:	IN[0]	0100 _{hex}	IN[1]:	xxxx _{hex}
Error during execution:	IN[0]	8100 _{hex}	IN[1]:	yyyy _{hex}

And so on until:

Read measured value for channel 8:	OUT[0]:	0700 _{hex}	OUT[1]:	0000 _{hex}
Command executed successfully:	IN[0]	0700 _{hex}	IN[1]:	xxxx _{hex}
Error during execution:	IN[0]	8700 _{hex}	IN[1]:	yyyy _{hex}

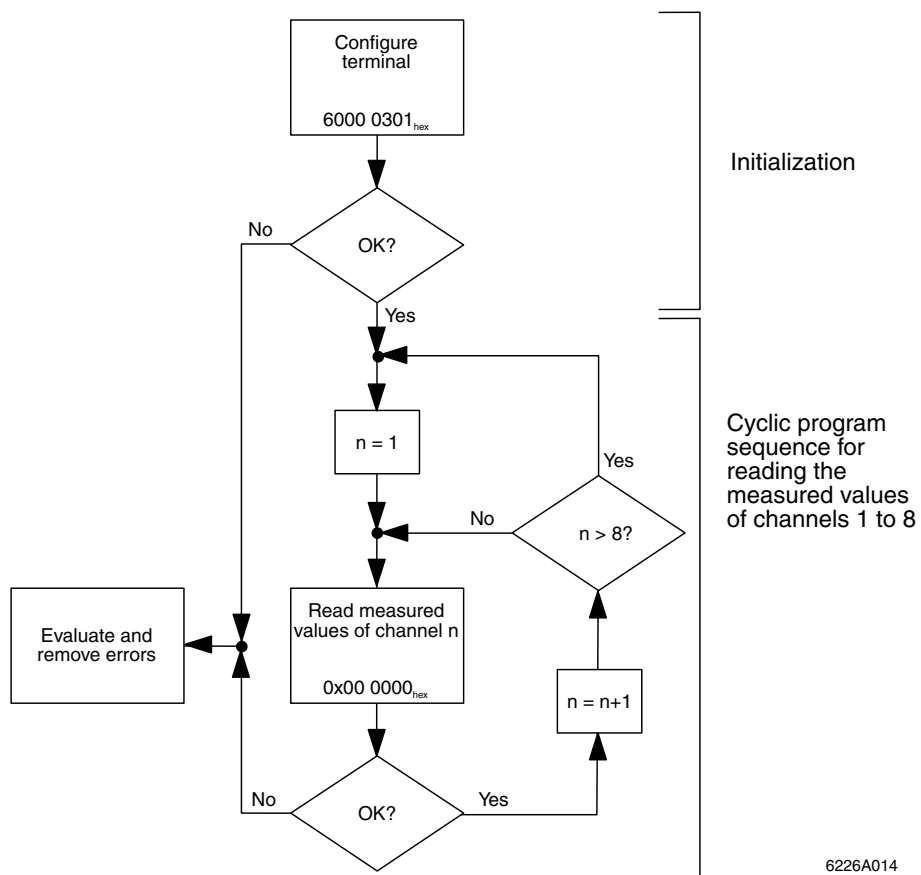

6226A014

Fig. 9 Schematic initialization and cyclic program sequence when configuring the entire terminal

16.2 Standard Method 2

Task:

- The input channels are to be operated in **different** configurations.
The channels are to be configured first (4x00_{hex}).
After configuration, the measured values are to be read (0x00_{hex}).
- Configuration of the channels:

Parameter	Channel 1	Channel 2	Channel 3	...
Filtering by mean-value generation:	No filtering (01 _{bin} , 1 _{dec})	16-sample average value (00 _{bin} , 0 _{dec})	4-sample average value (10 _{bin} , 2 _{dec})	...
Format:	IB IL (000 _{bin} , 0 _{dec})	IB IL (000 _{bin} , 0 _{dec})	IB IL (000 _{bin} , 0 _{dec})	...
Measuring range:	0 V to 50 V (0110 _{bin} , 6 _{dec})	0 V to 5 V (0010 _{bin} , 2 _{dec})	4 mA to 20 mA (1010 _{bin} , 10 _{dec})	...

Procedure:

- 1 Install the terminal.
- 2 Connect the voltage (power up).
- 3 Configure each individual channel in the terminal in turn (initialization phase, e.g., in the initialization phase of the application program).
- 4 Read the measured value for each channel in turn.

Initialization Phase:

Process data output word OUT[0] appears as follows for **all channels**:

OUT[0]																
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	Command							0	0	0	0	0	0	0	0
bin	0	1	0	0	0	Z ₂	Z ₁	Z ₀	0	0	0	0	0	0	0	0
hex	4				x				0				0			

Process data output word OUT[1] indicates the parameters for each channel according to the task.

For **channel 1**, it looks like this:

	OUT[1]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	0	0	0	0	0	Filter		0	Format			Measuring range			
bin	0	0	0	0	0	0	0	1	0	0	0	0	0	1	1	0
hex	0				1				0				6			

With the command in OUT[0], the configuration according to OUT[1] is sent to the module electronics for each channel. After configuration of a channel is complete, the command and the configuration are mirrored in the process data input words.

Configure channel 1:	OUT[0]:	4000 _{hex}	OUT[1]:	0106 _{hex}
Configuration completed successfully:	IN[0]	4000 _{hex}	IN[1]:	0106 _{hex}
Error during configuration:	IN[0]	C000 _{hex}	IN[1]:	0106 _{hex}
Configure channel 2:	OUT[0]:	4100 _{hex}	OUT[1]:	0002 _{hex}
Configuration completed successfully:	IN[0]	4100 _{hex}	IN[1]:	0002 _{hex}
Error during configuration:	IN[0]	C100 _{hex}	IN[1]:	0002 _{hex}
Configure channel 3:	OUT[0]:	4200 _{hex}	OUT[1]:	020A _{hex}
Configuration completed successfully:	IN[0]	4200 _{hex}	IN[1]:	020A _{hex}
Error during configuration:	IN[0]	C200 _{hex}	IN[1]:	020A _{hex}

Configure **channels 4 to 8** according to the example configurations shown.

A **cyclic program sequence, which reads the measured values of the individual channels**, takes place after the configuration for each individual channel has been completed successfully.

Process data output word OUT[0] appears as follows:

	OUT[0]															
Bit	15	14	13	12	11	10	9	8	7	6	5	4	3	2	1	0
Assignment	0	Command							0	0	0	0	0	0	0	0
bin	0	0	0	0	0	Z ₂	Z ₁	Z ₀	0	0	0	0	0	0	0	0
hex	0				X				0				0			

Command 0x00_{hex} does not require any parameters and the value of parameter word OUT[1] is 0000_{hex}.

With the command in OUT[0], the read request is sent to the module electronics. After the command has been executed, it is mirrored in process data input word IN[0] and the analog value (xxxx_{hex}) or a diagnostic message (yyyy_{hex}) is displayed in process data input word IN[1]. The appearance of the process data input and output words is the same as in example 1.

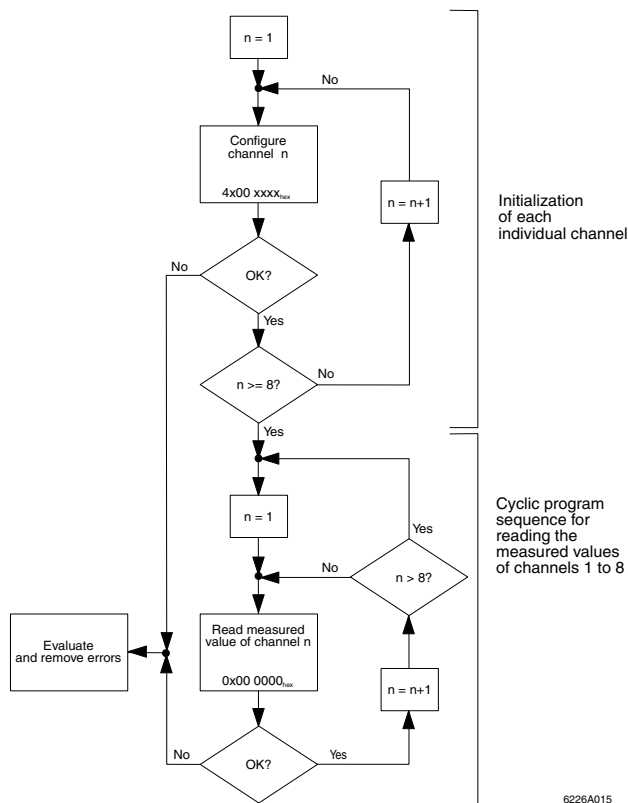


Fig. 10 Schematic initialization and cyclic program sequence when configuring channels with different parameters

16.3 Special Methods

The group commands are regarded as special methods.

Task:

- The measured values of channels 1 to 4 (group A) are to be read in one cycle and the measured values of channels 5 to 8 (group B) in another cycle (7000_{hex} for group A; 7100_{hex} for group B).
- The input channels are to be operated **in different** configurations (e.g., as in example 2).

Procedure:

- 1 Install the terminal.
- 2 Connect the voltage (power up).
- 3 Configure each individual channel in the terminal in turn (initialization phase, e.g., in the initialization phase of the application program). As the channels are to have different configurations, they must be configured using command 4x00_{hex}.
- 4 Use group command 7000_{hex} to read the measured values for channels 1 to 4 simultaneously. Then use group command 7100_{hex} to read the measured values for channels 5 to 8. Both groups can be reread cyclically.

16.4 Advantages of Standard Methods Over Special Methods

- Standard methods read the measured values with greater reliability because the command is mirrored for every measured value. Thus, it is possible to detect precisely which channel supplied the measured value.
- Standard methods enable more accurate error diagnostics than special methods.
- If you switch the group command for reading the channels (e.g., between 7000_{hex} and 7100_{hex} when reading two groups of four channels each), you must allow sufficient time to do so. It must be ensured that the received measured values belong to the requested group. This can only be ensured using waiting times.

17 Application Notes

Notes on typical applications are provided here in order to facilitate optimum use of the terminal in different operating modes.

17.1 Precision DC Measurements

Precision DC measurements constitute an optimum area of application for the terminal. The high-resolution analog/digital converter and excellent instrumentation amplifier technology achieve a very high level of accuracy (typically 0.02% in the voltage range).

In order to take full advantage of these features, the following configurations are recommended:

- Measured value acquisition: According to standard method 1 or 2
- Format: IB IL (high-resolution)
- Filtering: 32-sample average value

This suppresses undesirable interference signals and provides a low-noise, accurate measured result. Non-time-critical, i.e., slow, processes are a prerequisite for this configuration.

17.2 Closed-Loop Control Tasks

The terminal makes closed-loop control tasks particularly easy to implement. In INTERBUS networks, the terminal supports the advantages with regard to time equidistance. As the terminal scans input signals synchronously with the bus clock and the bus runtime has a very small jitter, the input signals can be scanned equidistantly. Thus, the measured results are particularly suitable for use in closed-loop control.

The following configurations and measures are recommended:

- Measured value acquisition: According to standard method 1 or 2
In special cases, group commands (7x00_{hex}) can be an exception.
- Filtering: No mean-value generation
As total accuracy is often irrelevant in closed-loop control tasks, filtering is not necessary. This increases the dynamic response of the terminal and speeds up the closed-loop control circuit.
- Adjust the local bus cycle time to the firmware runtime.
Example for INTERBUS: In standard method 1, the firmware runtime is < 800 µs, i.e., the INTERBUS cycle time should be set to 800 µs.

In applications in which an 8-bit resolution is sufficient, group commands 7000_{hex} and 7100_{hex} can be used to read four channels simultaneously. Scanning is synchronous with the bus clock here too. Four channels require < 1500 µs.

17.3 Signal Scanning or Fast, Sudden Signals

The terminal is ideal for scanning signals. As a result of the high input limit frequency (3.5 kHz), there are no limiting elements in the analog stage. The maximum signal frequency that can be scanned depends on the firmware runtime and the INTERBUS cycle time.

The terminal measuring device can measure signals with a frequency of $1/800 \mu\text{s} = 1.25 \text{ kHz}$. According to Shannon's sampling theorem, therefore, the signal frequency that can be scanned is $1.25 \text{ kHz} / 2 = 0.625 \text{ kHz}$.


This signal frequency can only be achieved if sufficiently fast bus operation can be ensured.

The following configurations and measures are recommended:

- Measured value acquisition: According to standard method 1 or 2
- Filtering: No mean-value generation
This increases the dynamic response of the terminal.
- Adjust the local bus cycle time to the firmware runtime.
This achieves discrete periods of scanning.
Example for INTERBUS: In standard method 1, the firmware runtime is < 800 µs, i.e., the INTERBUS cycle time should be set to 800 µs.

17.4 Linked Voltages

When using linked voltages, ensure that the terminal has eight single-ended inputs. A common ground potential should be used with linked voltages. As the terminal has many measuring ranges, for example the 0 V to 50 V range, and the resolution is high enough, applications with several linked voltages can also be implemented without any problems.

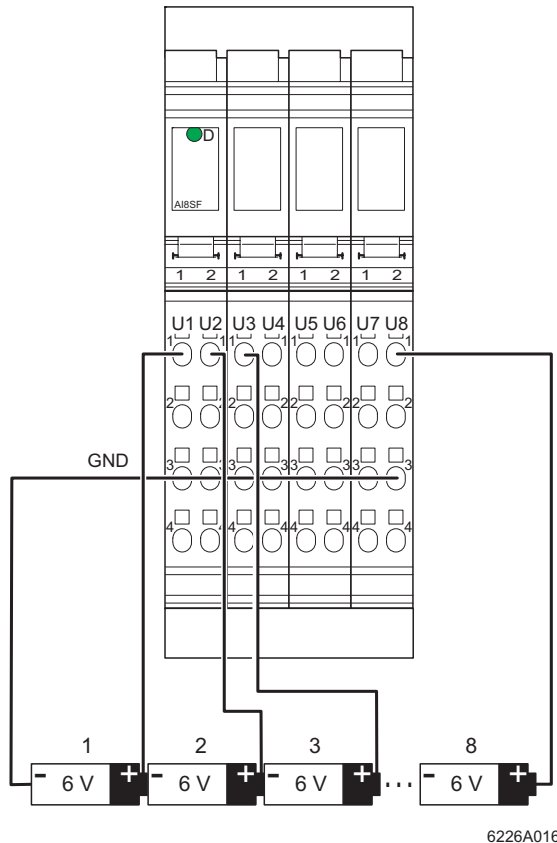


6226A016

Fig. 11 Measuring linked voltages

17.5 Current Loops

If the terminal is used to measure currents in current loops, make sure that the eight current inputs operate on a common ground potential (single-ended). Thus, the measuring input should always be on the GND potential with the minus input.

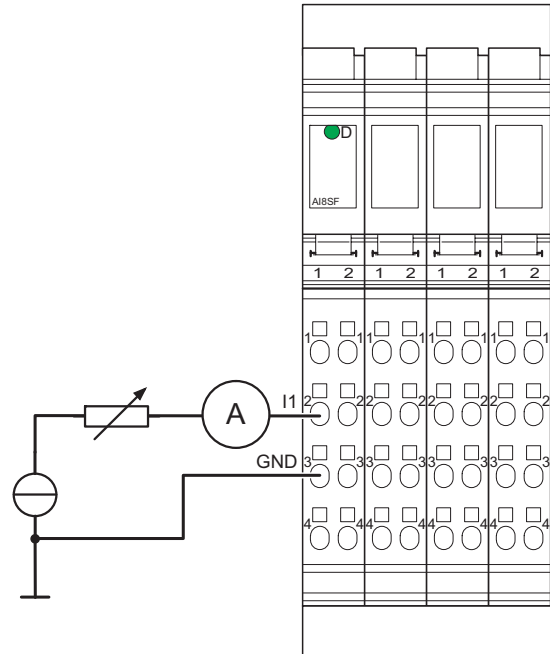

6226A017

Fig. 12 Measuring currents

17.6 Passive Sensors

When using passive sensors, please use the R-IB IL AI 8/IS-PAC terminal.

18 Tolerance and Temperature Response

Voltage Inputs

$T_A = 25^\circ\text{C}$

Measuring Range	Absolute (Typical)	Absolute (Maximum)	Relative (Typical)	Relative (Maximum)
0 V to 5 V; ± 5 V	± 1.0 mV	± 5.0 mV	$\pm 0.02\%$	$\pm 0.10\%$
0 V to 10 V; ± 10 V	± 2.0 mV	± 10.0 mV	$\pm 0.02\%$	$\pm 0.10\%$
0 V to 25 V; ± 25 V	± 5.0 mV	± 25.0 mV	$\pm 0.02\%$	$\pm 0.10\%$
0 V to 50 V	± 10.0 mV	± 50.0 mV	$\pm 0.02\%$	$\pm 0.10\%$

$T_A = -25^\circ\text{C} \dots +55^\circ\text{C}$

Measuring Range	Absolute (Typical)	Absolute (Maximum)	Relative (Typical)	Relative (Maximum)
0 V to 5 V; ± 5 V	± 5.0 mV	± 15.0 mV	$\pm 0.10\%$	$\pm 0.30\%$
0 V to 10 V; ± 10 V	± 10.0 mV	± 30.0 mV	$\pm 0.10\%$	$\pm 0.30\%$
0 V to 25 V; ± 25 V	± 25.0 mV	± 75.0 mV	$\pm 0.10\%$	$\pm 0.30\%$
0 V to 50 V	± 50.0 mV	± 150.0 mV	$\pm 0.10\%$	$\pm 0.30\%$

Current Inputs

$T_A = 25^\circ\text{C}$

Measuring Range	Absolute (Typical)	Absolute (Maximum)	Relative (Typical)	Relative (Maximum)
0 mA to 20 mA; 4 mA to 20 mA; ± 20 mA	± 8.0 μA	± 40.0 μA	$\pm 0.04\%$	$\pm 0.20\%$
0 mA to 40 mA; ± 40 mA	± 16.0 μA	± 80.0 μA	$\pm 0.04\%$	$\pm 0.20\%$

$T_A = -25^\circ\text{C} \dots +55^\circ\text{C}$

Measuring Range	Absolute (Typical)	Absolute (Maximum)	Relative (Typical)	Relative (Maximum)
0 mA to 20 mA; 4 mA to 20 mA; ± 20 mA	± 28.0 μA	± 80.0 μA	$\pm 0.14\%$	$\pm 0.40\%$
0 mA to 40 mA; ± 40 mA	± 56.0 μA	± 160 μA	$\pm 0.14\%$	$\pm 0.40\%$

Additional Tolerances Influenced by Electromagnetic Fields

Type of Electromagnetic Interference	Typical Deviation of the Measuring Range Final Value (Voltage Input)	Typical Deviation of the Measuring Range Final Value (Current Input)
	Relative	Relative
Electromagnetic fields; field strength 10 V/m according to EN 61000-4-3/IEC 61000-4-3	$< \pm 2\%$	$< \pm 2\%$
Conducted interference Class 3 (test voltage 10 V) according to EN 61000-4-6/IEC 61000-4-6	$< \pm 1\%$	$< \pm 1\%$
Fast transients (burst) 4 kV supply, 2 kV input according to EN 61000-4-4/IEC 61000-4-4	$< \pm 1\%$	$< \pm 1\%$



The values refer to nominal operation in the recommended mounting position.

DOK-CONTRL-ILA8/
SF***-KB02-EN-P

Bosch Rexroth AG
Electric Drives and Controls
Postfach 13 57
97803 Lohr, Germany
Bgm.-Dr.-Nebel-Str. 2
97816 Lohr, Germany
Tel. +49-(0) 93 52 - 40-50 60
Fax. +49-(0) 93 52 - 40-49 41
service.svc@boschrexroth.de
www.boschrexroth.com

All rights reserved. No part of this document may be reproduced or stored, processed, duplicated or circulated using electronic systems, in any form or by any means, without the prior written authorization of Bosch Rexroth AG, Electric Drives and Controls. Violations shall give rise to claims for damages. The data specified above only serve to describe the product. They do not indicate any specific condition or suitability for a certain application. It must be remembered that our products are subject to natural wear and aging.

Reprint forbidden - subject to modifications